


# CR2

Circular fire damper for large diameters



CE  
0749

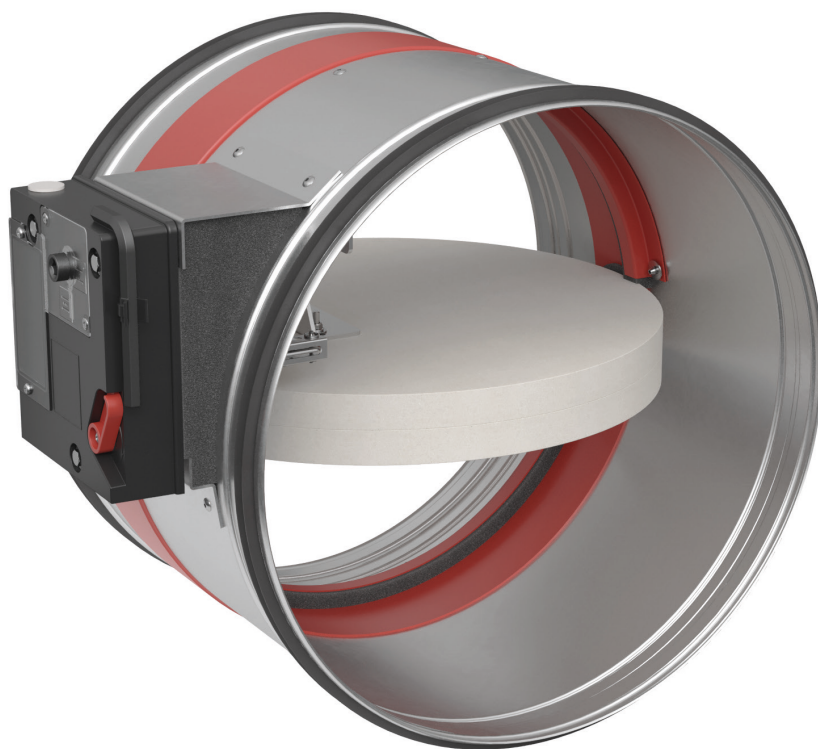

UK  
CA








## Table of content

Declaration of performance	4
Product presentation CR2	5
Range and dimensions CR2	5
Variant CR2-L500	6
Range and dimensions CR2-L500	6
Evolution - kits	7
Options - at the time of order	11
Storage and handling	12
Installation	12
Installation at a minimal distance from another damper or from an adjacent supporting construction	13
Installation in rigid wall	14
Installation in rigid floor (125 mm)	16
Installation in rigid floor (150 mm)	17
Installation in flexible wall (metal stud gypsum plasterboard wall)	19
Installation in flexible wall (metal stud gypsum plasterboard wall), sealing with gypsum	21
Installation in flexible wall (metal stud gypsum plasterboard wall), sealing with mortar	23
Installation in gypsum block wall	25
Installation in flexible and rigid wall, sealing with rigid stone wool boards with coating	27
Installation in rigid floor, sealing with rigid stone wool boards with coating	31
Inspection of the damper via UL option or via the fusible link opening of the ONE mechanism	33
Operation and mechanisms	35
Electrical connection	40
Weights	42
Selection data	43
Example	43
Sample order	44
Approvals and certificates	45

## Explanation of the abbreviations and pictograms

Wn = nominal width	E.TELE = power supply magnet	Sn = free air passage
Hn = nominal height	E.ALIM = power supply motor	$\zeta$ [-] = pressure loss coefficient
Dn = nominal diameter	V = volt	Q = airflow
E = integrity	W = watt	$\Delta P$ = static pressure drop
I = thermal insulation	Auto = automatic	v = air speed in the duct
S = smoke leakage	Tele = remote controlled	Lwa = A-weighted sound power level
Pa = pascal	Pnom = nominal capacity	Lw oct = sound power level per octave
ve = vertical wall penetration	Pmax = maximum capacity	midband
ho = horizontal floor penetration	GKB (type A) / GKF (type F): "GKB"	dB(A) = A-weighted decibel value
o -> i = meets the criteria from the outside	stands for standard plasterboards (type	$\Delta L$ = correction factor
(o) to the inside (i)	A according to EN 520) while "GKF"	
i <-> o = fire side not important	plasterboards offer a higher fire resistance	
V AC = Volt alternating current	for a similar plate thickness (type F	
V DC = Volt direct current	according to EN 520)	
	Cal-Sil = calcium silicate	
	OP = option (delivered with the product)	
	KIT = kit (delivered separately for repair or	
	upgrade)	
	PG = connection flange to the duct	

	large dimensions		air tightness in accordance with EN 1751: class ATC 4 (formerly B), class ATC 3 in option (formerly C)
	suitable for built-in installation		minimal distance allowed
	sealing with fire resistant stone wool boards allowed, also for asymmetric opening		

DECLARATION OF PERFORMANCE

CE DoP Rf-t C1 EN - K-01/10/2024

1. Unique identification code of the product-type:	CR2
2. Intended use(s):	Circular fire damper to be used in conjunction with partitions to maintain fire compartments in heating, ventilating and air conditioning installations.
3. Manufacturer:	Rf-Technologies NV, Lange Ambachtsstraat 40, B-9860 Oosterzele
4. System/s of AVCP:	System 1
5. Harmonised standard / European Assessment Document; notified body / European Technical Assessment, Technical Assessment Body, notified body; certificate of constancy of performance:	EN 15650:2010, BCCA with identification number 0749; BCCA-0749-CPR-BC1-606-0464-15650.01-2517
6. Declared performance according to EN 15650:2010	(Fire resistance according to EN 1366-2 and classifications according to EN 13501-3)

Essential characteristics		Performance	
Range	Type	Wall	Sealing
Ø 200-630 mm	Rigid wall	Aerated concrete ≥ 100 mm	Mortar / Gypsum
			Stone wool + coating ≥ 140 kg/m³
			Stone wool Mulcol Multimastic FB1 + coating
	Rigid floor	Aerated concrete ≥ 125 mm Aerated concrete ≥ 150 mm	Stone wool Pyro-Safe® MFP + coating
			Mortar
			Mortar
	Flexible wall	Metal studs:gypsum plasterboard Type A (EN 520) ≥ 100 mm	Stone wool + coating ≥ 140 kg/m³
			Stone wool ≥ 40 kg/m³ + cover plates
			Gypsum
			Mortar
		Metal studs:gypsum plasterboard Type F (EN 520) ≥ 100 mm	Stone wool + coating ≥ 140 kg/m³
			Stone wool ≥ 40 kg/m³ + cover plates
			Gypsum
			Mortar
		Paroc System Panel Sandwich panel type Paroc AST S ≥ 100 mm	Stone wool Mulcol Multimastic FB1 + coating
			Stone wool + coating ≥ 140 kg/m³
			Stone wool Pyro-Safe® MFP + coating
			Hiti CFS-CT B 1 S
		Gypsum blocks ≥ 70 mm	Block glue

1	Type of installation: built-in, 0-360°. Minimal distances authorised with axis till 45°.	360° 30°	Type of installation: built-in, 0-360°. Minimal distances authorised.	360° 30°	30°	30°
4	Type of installation: built-in, 0/180° (CR)	360° 30°				
Nominal activation conditions/sensitivity:						
Response delay (response time): closure time						
Operational reliability: cycling						
Durability of response delay:						
Durability of operational reliability:						
Protection against corrosion according to EN 60068-2-52:						
Damper casing leakage according to EN 1751:						
The performance of the product identified above is in conformity with the set of declared performance/s. This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.						



Signed for and on behalf of the manufacturer by:  
**Duchan Laplace**, R&D Manager



Oosterzele, 01/10/2024



## Product presentation CR2

Circular fire damper available in the largest dimensions (up to a diameter of 630 mm) with a fire resistance up to 120 minutes. Its refractory tunnel is made of galvanised steel and its blade consists of asbestos-free panels, which are resistant to humidity.


Fire dampers are installed where air ducts penetrate fire-resistant compartment walls. Their role is to restore the fire resistance grade of the penetrated wall and to prevent smoke propagation. Fire dampers are distinguished by their degree of fire resistance, by their aerodynamic properties as well as by their installation ease. Rf-Technologies' fire dampers are all CE marked. They can be equipped with various types of mechanisms depending on the specific needs linked to the project or to the local regulations.

### ✓ large dimensions




- suitable for built-in installation
- minimal distance allowed
- suitable for rigid wall, rigid floor and light wall (metal stud gypsum plasterboard wall, gypsum blocks)
- sealing with fire resistant stone wool boards allowed, also for asymmetric opening
- air tightness in accordance with EN 1751: class ATC 4 (formerly B), class ATC 3 in option (formerly C)
- tested according to EN 1366-2 up to 500 Pa
- operating mechanism outside the wall
- maintenance-free
- for indoor use
- operating temperature: max. 50°C

1. casing in galvanised steel
2. damper blade
3. operating mechanism
4. sealing cold smoke
5. blade bumper
6. intumescent strip
7. fusible link
8. rubber sealing ring
9. product identification

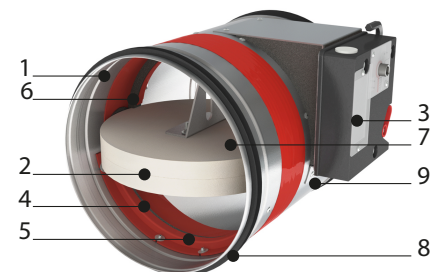

## Range and dimensions CR2

ØDn [mm]	200	250	315	355	400	450	500	560	630
----------	-----	-----	-----	-----	-----	-----	-----	-----	-----



Exceeding blade: X = on the mechanism side, Y = on the wall side


ØDn [mm]	315	355	400	450	500	560	630
x	-	-	-	-	-	15	50
y	24	44	66	91	116	146	181

## Variant CR2-L500

### Variant CR2-L500


CR2 damper with a tunnel casing extension at the wall side to facilitate the connection to the duct when the supporting construction is thicker than 100 mm.

1. casing in galvanised steel
2. damper blade
3. operating mechanism
4. sealing cold smoke
5. blade bumper
6. intumescent strip
7. fusible link
8. rubber sealing ring
9. product identification

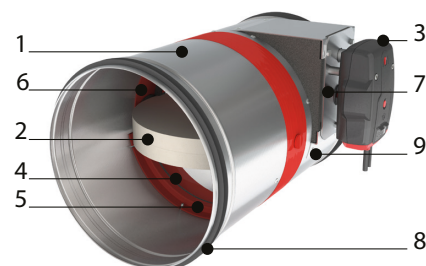

### Range and dimensions CR2-L500


ØDn [mm]	200	250	315	355	400	450	500	560	630
----------	-----	-----	-----	-----	-----	-----	-----	-----	-----




Exceeding blade: X = on the mechanism side, Y = on the wall side

ØDn [mm]	560	630
x	15	50
y	21	56

ØDn < 315 mm



ØDn ≥ 315 mm



	CFTH	ONE (X)	BFL(T)		CFTH	ONE (X)	BFL(T)	BFN(T)
<b>P</b>	81	105	101	<b>P</b>	85	105	104	104
<b>Q</b>	182	199	110	<b>Q</b>	182	199	110	110
<b>Z</b>	58	60	80	<b>Z</b>	156	157	179	179

## Evolution - kits



**KIT ONE T 24 FDCB**

Spring return actuator ONE 24V (with fusible link T) + bipolar beginning- and end-of-range switch



**KIT ONE T 24 FDCU**

Spring return actuator ONE 24V (with fusible link T) + unipolar beginning- and end-of-range switch



**KIT ONE T 24 FDCU ST**

Spring return actuator ONE 24V (with fusible link T) + unipolar beginning- and end-of-range switch + plug (ST)



**KIT ONE T 230 FDCB**

Spring return actuator ONE 230V (with fusible link T) + bipolar beginning- and end-of-range switch



**KIT ONE T 230 FDCU**

Spring return actuator ONE 230V (with fusible link T) + unipolar beginning- and end-of-range switch



**KIT ONE T 230 FDCU ST**

Spring return actuator ONE 230V (with fusible link T) + unipolar beginning- and end-of-range switch + plug (ST)



**KIT ONE-X 24**

Spring return actuator ONE-X 24V (with fusible link T)


**KIT ONE-X 230**


Spring return actuator ONE-X 230V (with fusible link T)


**KIT CFTH**

Automatic unlocking mechanism CFTH with FCU and without FTH 72


**KIT BFL24**

Spring return actuator BFL 24V


**KIT BFL24-ST**

Spring return actuator BFL 24V with plug (ST)


**KIT BFL230**

Spring return actuator BFL 230V


**KIT BFLT24**









Spring return actuator BFL 24V with thermo-electric fuse (T)


**KIT BFLT24-ST**

Spring return actuator BFL 24V with thermo-electric fuse (T) and plug (ST)


**KIT BFLT230**

Spring return actuator BFL 230V with thermo-electric fuse (T)

	<b>KIT BFLT230-ST</b>	Spring return actuator BFL 230V with thermo-electric fuse (T)
	<b>KIT BFN24</b>	Spring return actuator BFN 24V
	<b>KIT BFN24-ST</b>	Spring return actuator BFN 24V with plug (ST)
	<b>KIT BFN230</b>	Spring return actuator BFN 230V
	<b>KIT BFN24</b>	Spring return actuator BFN 24V with thermo-electric fuse (T)
	<b>KIT BFN24-ST</b>	Spring return actuator BFN 24V with thermo-electric fuse (T) and plug (ST)
	<b>KIT BFN230</b>	Spring return actuator BFN 230V with thermo-electric fuse (T)
	<b>KIT BFN230-ST</b>	Spring return actuator BFN 230V with thermo-electric fuse (T)

**KIT FDC CFTH**

1 limit switch (FCU/DCU/FCB/DCB)

**KIT SN2 BFL/BFN**

Auxiliary limit switch 'open/closed'

**KIT FTH72**

Fusible link FTH 72°C (for CFTH)

**KIT ZBAT 72**

Black spare part for thermo-electric fuse for BFLT/BFNT

**FUS72 ONE**

Fusible link 72°C

**MECT**

Testbox for mechanisms 24/48 V (magnet, motor, beginning and end of range switches)

**KIT BPLATE ONE(-X)**




Set of base plate and mounting parts for spring return actuators ONE and ONE-X. Only applicable for fire dampers type CR2, CU2(/B), CU4, CU2-15. To be used when changing the type of mechanism if no base plate is present with the original mechanism or a different type of base plate was used. Mounting in combination with a ONE(-X) type motor kit.

**KIT BPLATE BFL/BFN**



Set of base plate and mounting parts for spring return actuators type BFL(T) or BFN(T). Only applicable for fire dampers type CR2, CU2(/B), CU4, CU2-15. To be used when changing the type of mechanism if no base plate is present with the original mechanism or another type of base plate was used. Mounting in combination with a motor kit type BFL(T) or BFN(T).

**KIT BPLATE BF**

Set of base plate and mounting parts for spring return actuators type BF(T). Only applicable for fire dampers type CR2, CU2(/B), CU4, CU2-15 produced before 1/7/2015.

	<b>EPP CR2</b>	Kit with 4 cover plates (gypsum plasterboard 12.5 mm) for CR2 in light wall.
	<b>INSPECAM</b>	Sturdy digital endoscope for the internal inspection of fire dampers through an optional inspection opening. The endoscope features a 1 meter long probe with a diameter of 8,2 mm equipped with a dimmable LED, a removable 4x zoom, a colour LCD monitor 3.5". Photographic capture 3MP and video capture 720P.
	<b>KIT UG8</b>	The UG8 optical smoke detector is a standalone unit for duct mounting. It samples air in the ventilation duct via the venturi-tube and analyses it in the housing situated outside of the duct. The UG8 is CE-marked product, certified according to EN54-27. It can be connected directly with a fire damper: in the event of smoke detection, the UG8 shuts off the power to the fire damper actuator and closes the damper. The UG8 is fitted with LEDs showing normal operation, smoke alarm, contamination and service alarms. The status can also be checked remotely via relay outputs.

## Options - at the time of order

	<b>UL</b>	Inspection opening to visually determine the state and the position of the damper, by using an endoscope.
	<b>EN1751_ATC_3</b>	Air-tightness class ATC 3 (formerly C) (note: for CU2 H > 600 or W > 800 / for CR2 Ø > 315).

## Storage and handling

As this product is a safety element, it should be stored and handled with care.

### Avoid:

- any kind of impact or damage
- contact with water
- deformation of the casing

### It is recommended:

- to unload in a dry area
- not to flip or roll the product to move it
- not to use the damper as a scaffold, working table, etc.
- not to store smaller dampers inside larger ones

## Installation


### General points

- The installation must comply with the installation manual and the classification report.
- Axis orientation: see the declaration of performance.
- Avoid obstruction of adjoining ducts.
- Product installation: always with closed damper blade.
- Verify if the blade can move freely.
- Please observe safety distances with respect to other construction elements. The operating mechanism must also remain accessible: allow for a clearance of 200 mm around the housing.
- The air tightness class will be maintained if the damper is installed according to the installation manual.
- Rf-t fire dampers are always tested in standardised constructions according to EN 1366-2. The achieved results are valid for similar supporting constructions with a fire resistance, thickness and density equal or superior to the supporting construction used during the test.
- If the wall thickness exceeds the minimum thickness specified in our installation instructions, the following conditions apply to the sealing depth:
  - For flexible walls and sandwich panel system walls, the seal must always be applied over the full depth of the wall.
  - With rigid walls, rigid floors and plaster block walls, the minimum sealing depth as indicated in our installation instructions (often equal to the minimum wall thickness) is sufficient. Apply the seal at the height of the damper blade (from the wall limit indication).
- When installing a fire damper in a flexible metal stud wall, some installation methods do not require reinforcing profiles around the wall opening from a fire protection point of view (see below). Always follow the general instructions of the manufacturer of these wall systems when building this type of wall.
- The damper must remain accessible for inspection and maintenance.
- Schedule at least 2 visual checks each year.




TEST

2023	<input checked="" type="checkbox"/>		<input checked="" type="checkbox"/>
2024	<input checked="" type="checkbox"/>		<input checked="" type="checkbox"/>
2025	<input checked="" type="checkbox"/>		<input type="checkbox"/>
2026	<input type="checkbox"/>		<input type="checkbox"/>
2027	<input type="checkbox"/>		<input type="checkbox"/>





## Installation at a minimal distance from another damper or from an adjacent supporting construction

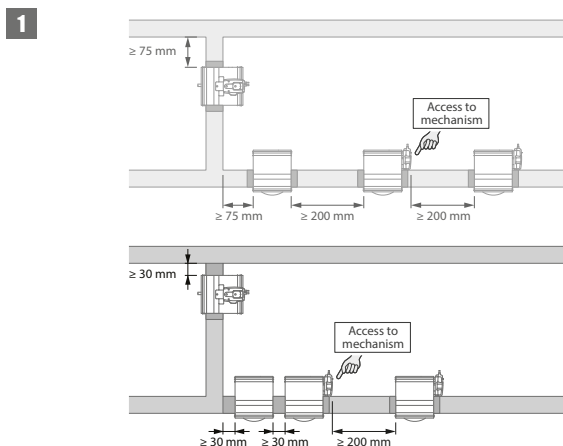


### 1. Principle

According to the European test standard EN 1366-2, a fire damper must be installed at a minimum distance of 75 mm from an adjacent supporting construction (wall/floor) and 200 mm from another damper, unless the solution was tested at a shorter distance.

This range of Rf-t fire dampers has been successfully tested and can be installed in a vertical or horizontal supporting construction, at a distance below the minimum set by the standard.


For circular dampers, the minimal distance is set to 30 mm.

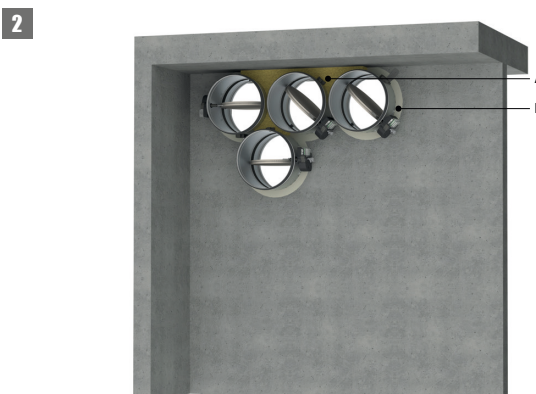

### 2. Certified solution

For the Rf-t fire dampers, the solution consists of the following elements: A: Universal sealing for minimal distance; B: Sealing compliant with existing classifications (Declaration of Performance).

- A. Sealing of the opening at the side with minimal distances between damper and wall/ceiling or another fire damper: rigid stone wool panels ( $150 \text{ kg/m}^3$ ) are applied to a depth of min. 400 mm, of which 150 mm on the mechanism side of the wall. On the non-mechanism side of the wall, the stone wool panels must be at least flush with the wall. The surface of this sealing is set between the axes (centres) of the dampers.
- B. Sealing of the rest of the opening according to the existing classifications for the fire damper (Declaration of Performance).  
This also applies to circular dampers that are mounted at a minimum distance from one another (30 to 200 mm) but at a distance greater than 75 mm from a wall/ceiling. Detailed information for each wall/sealing combination can be found in the respective installation methods.

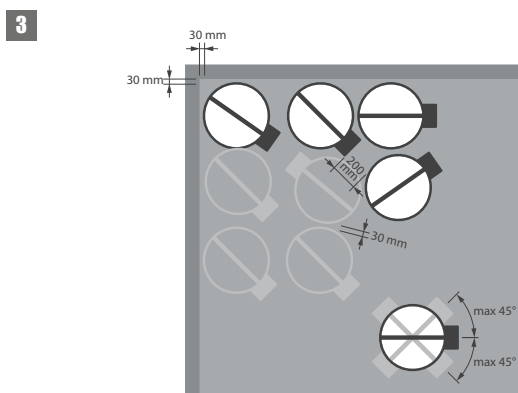

### 3. Restrictions

The orientation of the blade axis should be horizontal or oriented at a maximum of  $45^\circ$ .

A maximum of 3 circular dampers can be installed at a minimum distance from one another, both vertically and horizontally (with a maximum cluster of 4 dampers).


Note: when sealing the opening with panels of fire resistant stone wool, the maximum number of dampers also depends on the maximum "blank seal" allowed for the selected sealing material. Please refer to the manufacturer's instructions for this information.

## Installation in rigid wall


The product was tested and approved in:

Range	Wall type	Sealing	Classification
Ø 200-630 mm	Rigid wall	Aerated concrete $\geq 100$ mm	Mortar / Gypsum
Ø 200-630 mm	Rigid wall	Aerated concrete $\geq 100$ mm	Mortar / Gypsum


1

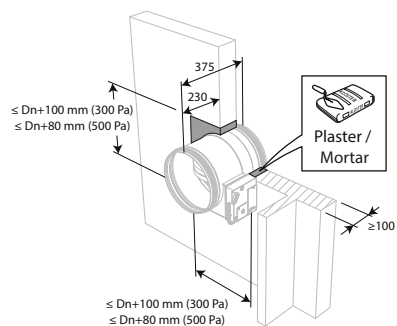


2

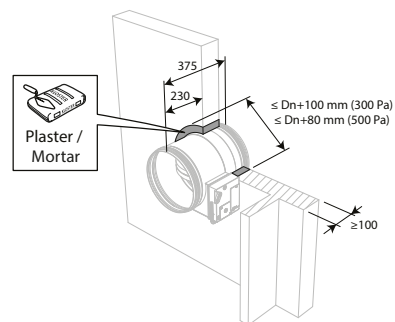

3




4

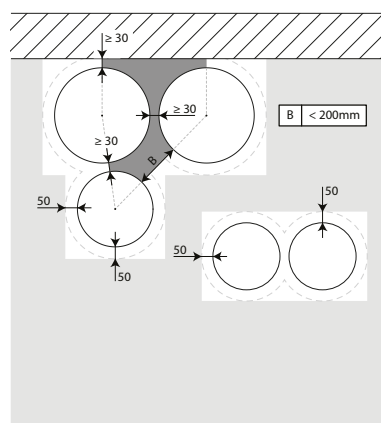


4. The dampers can be installed at a minimum distance ( $\geq 30$  mm) from an adjacent wall or from another damper.

5

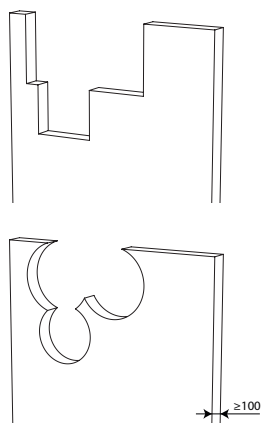

5. Make the necessary openings ( $\leq D_n + 100$  mm) / ( $\leq D_n + 80$  mm) in the wall.


6

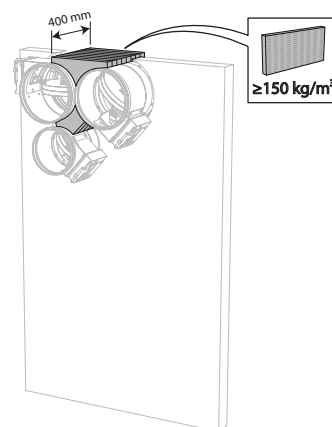

6. Mount the dampers in the opening.  
Apply rigid stone wool panels ( $\geq 150$  kg/m<sup>3</sup>) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.  
The surface of this sealing is set between the axes (centres) of the dampers.

- ⚠ Caution:** the opening is sealed according to the existing classification (see next point) when:
- 2 fire dampers are installed at a minimum distance from one another but at a normal distance ( $\geq 75$  mm) from the wall or floor/ceiling.
  - One single (no cluster) fire damper is located at a minimum distance ( $\leq 75$  mm) from a wall or floor/ceiling.

7


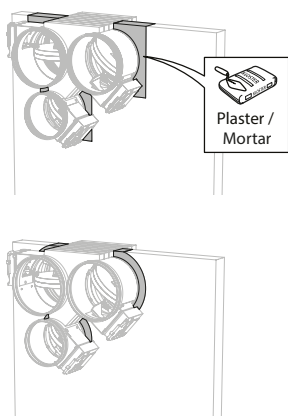


7. Seal the rest of the opening with standard mortar or gypsum.

## Installation in rigid floor (125 mm)

The product was tested and approved in:

Range	Wall type	Sealing	Classification
Ø 200-630 mm	Rigid floor	Aerated concrete ≥ 125 mm	Mortar
			El 90 ( $h_o$ i ↔ o) S - (500 Pa)

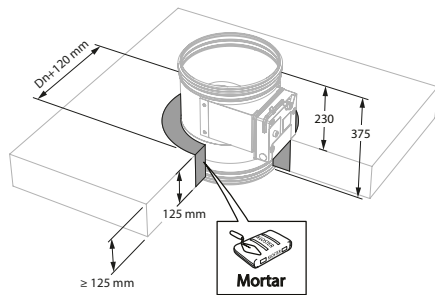**1****2**


TEST!

Installation in rigid floor (150 mm)


The product was tested and approved in:

Range	Wall type	Sealing	Classification
Ø 200-630 mm	Rigid floor	Aerated concrete ≥ 150 mm	Mortar
El 120 (h <sub>o</sub> i ↔ o) S - (500 Pa)			


1

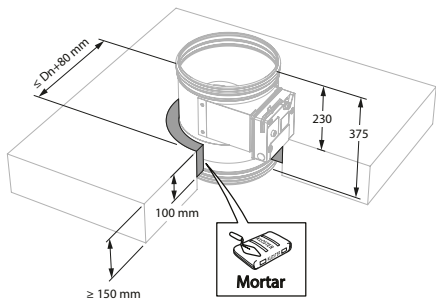

2




3

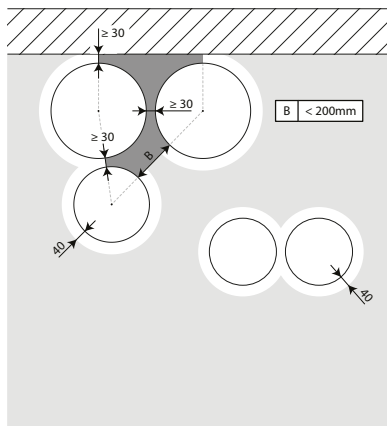


3. The dampers can be installed at a minimum distance (≥ 30 mm) from an adjacent wall or from another damper.

4

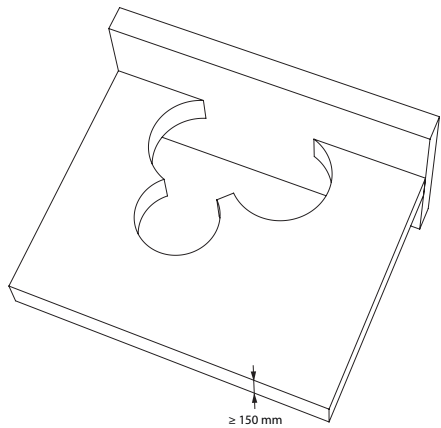

4. Make the necessary openings (≤ Dn + 80 mm) in the floor.


5

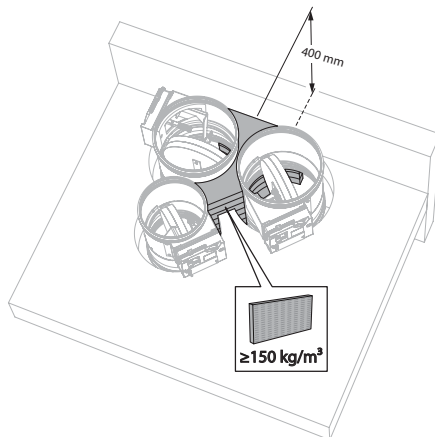

5. Mount the dampers in the opening.  
 Apply rigid stone wool panels ( $\geq 150 \text{ kg/m}^3$ ) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.  
 The surface of this sealing is set between the axes (centres) of the dampers.

- ⚠ Caution:** the opening is sealed according to the existing classification (see next point) when:
- 2 fire dampers are installed at a minimum distance from one another but at a normal distance ( $\geq 75 \text{ mm}$ ) from the wall or floor/ceiling.
  - One single (no cluster) fire damper is located at a minimum distance ( $\leq 75 \text{ mm}$ ) from a wall or floor/ceiling.

6




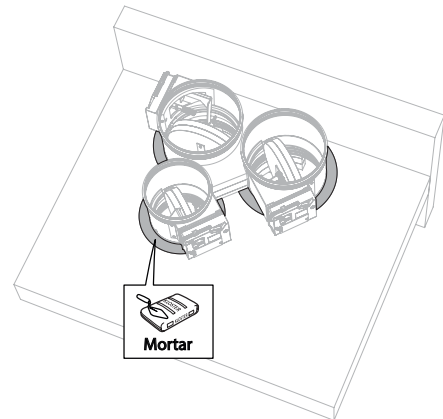


6. Seal the rest of the opening with standard mortar.


Installation in flexible wall (metal stud gypsum plasterboard wall)

The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 200-630 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) ≥ 100 mm	Stone wool ≥ 40 kg/m³ + cover plates	El 90 (v <sub>e</sub> i ↔ o) S - (300 Pa)
Ø 200-630 mm	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) ≥ 100 mm	Stone wool ≥ 40 kg/m³ + cover plates	El 60 (v <sub>e</sub> i ↔ o) S - (500 Pa)

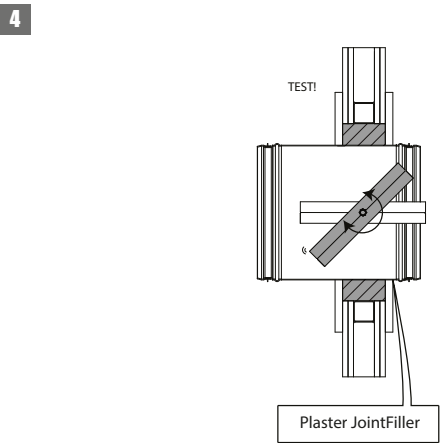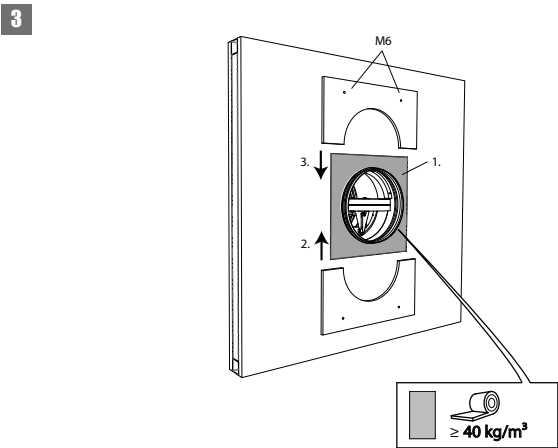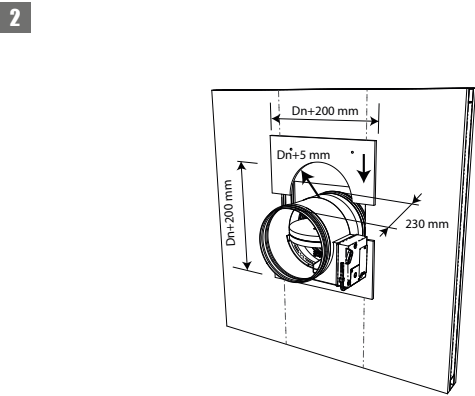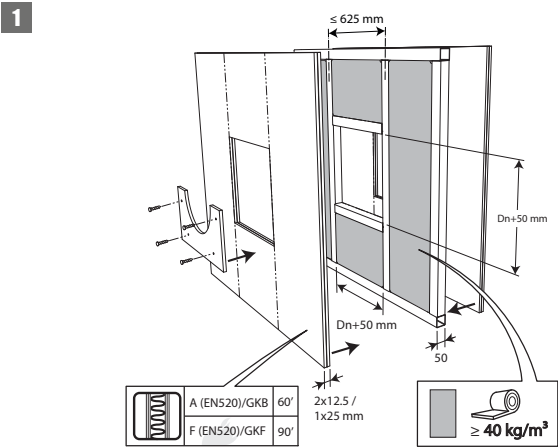


5

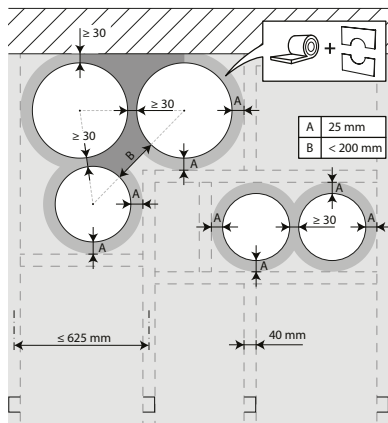

5. The dampers can be installed at a minimum distance ( $\geq 30$  mm) from an adjacent wall or from another damper.


7

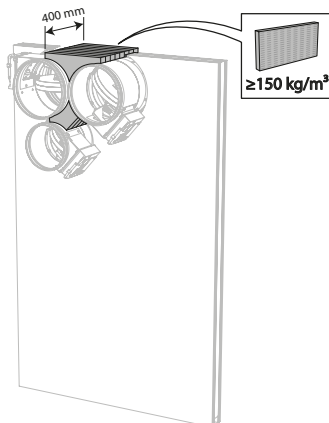

7. Mount the dampers in the opening.  
Apply rigid stone wool panels ( $\geq 150 \text{ kg/m}^3$ ) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.

- ⚠ Caution:** the opening is sealed according to the existing classification (see next point) when:
- 2 fire dampers are installed at a minimum distance from one another but at a normal distance ( $\geq 75$  mm) from the wall or floor/ceiling.
  - One single (no cluster) fire damper is located at a minimum distance ( $\leq 75$  mm) from a wall or floor/ceiling.


6

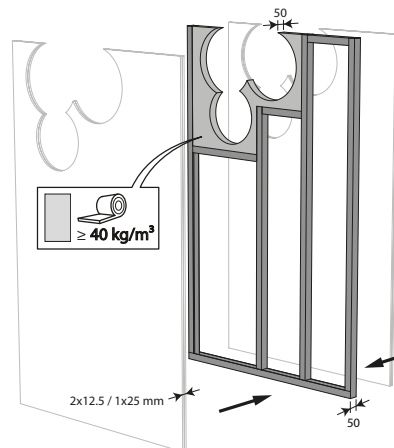

6. Build the drywall and mount horizontal and vertical studs around the opening.

In the opening around the dampers ( $D_n + 50$  mm), the void between the gypsum boards is filled with stone wool with a minimum density of  $40 \text{ kg/m}^3$ .

8




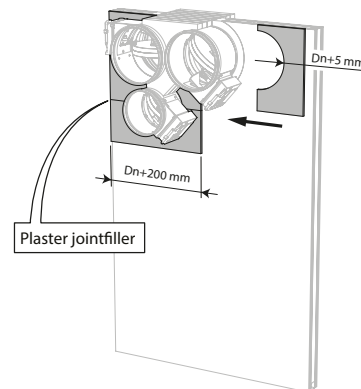


8. Apply cover plates (gypsum plasterboards) to finish the surface at both sides.  
Seal off the space between the plasterboards with jointfiller.



The product was tested and approved in:

Range	Wall type		Sealing	Classification
Ø 200-630 mm	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) ≥ 100 mm	Gypsum	El 60 (v <sub>e</sub> i ↔ o) S - (500 Pa)
Ø 200-630 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) ≥ 100 mm	Gypsum	El 120 (v <sub>e</sub> i ↔ o) S - (500 Pa)

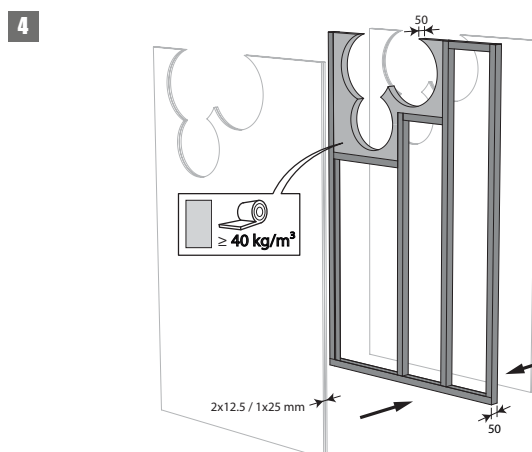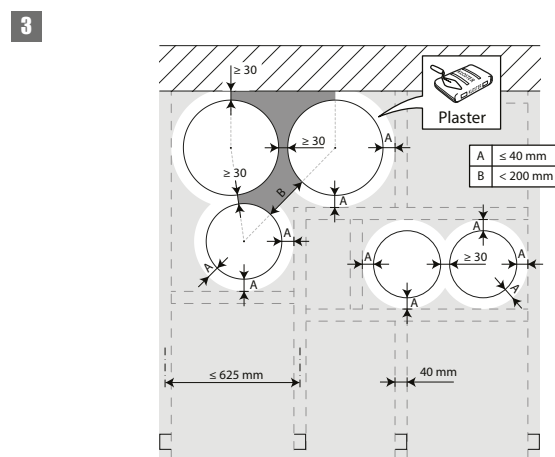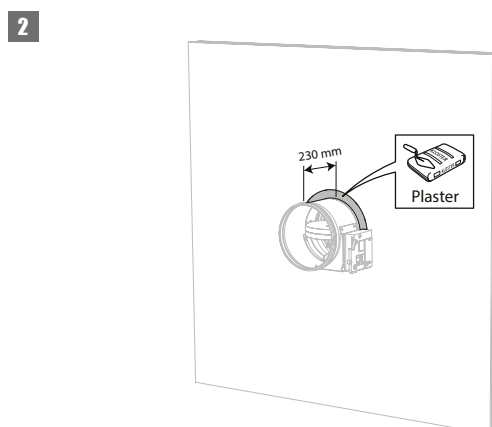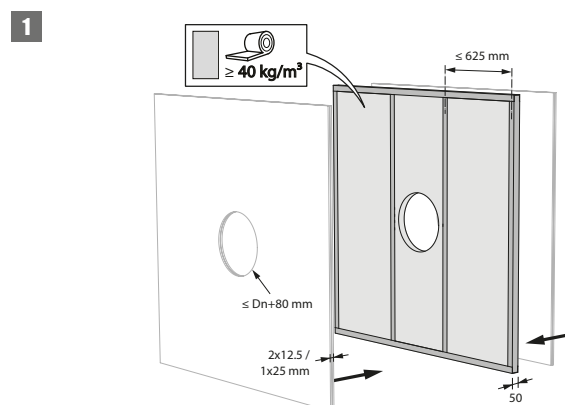


4. Build the drywall and mount horizontal and vertical studs around the opening.

When installing a single fire damper at a minimum distance from the ceiling, it is not necessary, from a fire technical point of view, to provide studs around the opening.

In the opening around the dampers, the void between the gypsum boards is partially filled (up to  $D_n + 80$  mm) with stone wool with a minimum density of  $40 \text{ kg/m}^3$ .


5

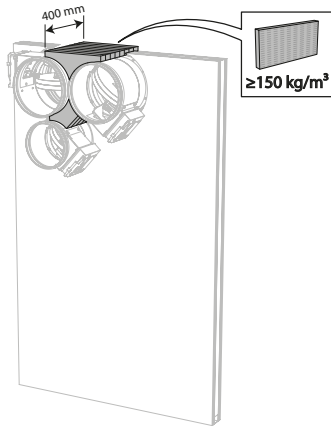

5. Mount the dampers in the opening.  
 Apply rigid stone wool panels ( $\geq 150 \text{ kg/m}^3$ ) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.  
 The surface of this sealing is set between the axes (centres) of the dampers.

- ⚠ Caution:** the opening is sealed according to the existing classification (see next point) when:
- 2 fire dampers are installed at a minimum distance from one another but at a normal distance ( $\geq 75 \text{ mm}$ ) from the wall or floor/ceiling.
  - One single (no cluster) fire damper is located at a minimum distance ( $\leq 75 \text{ mm}$ ) from a wall or floor/ceiling.

6






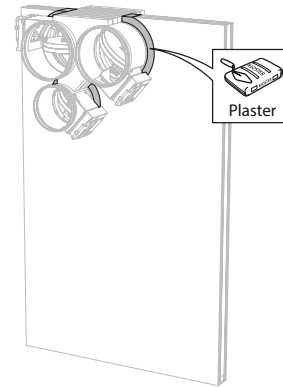


6. Seal the rest of the opening with standard gypsum across the entire wall thickness.

## Installation in flexible wall (metal stud gypsum plasterboard wall), sealing with mortar


The product was tested and approved in:

Range	Wall type	Sealing	Classification
Ø 200-630 mm	Flexible wall	Mortar	El 60 ( $v_e$ i $\leftrightarrow$ o) S - (300 Pa)
Ø 200-630 mm	Flexible wall	Mortar	El 90 ( $v_e$ i $\leftrightarrow$ o) S - (300 Pa)

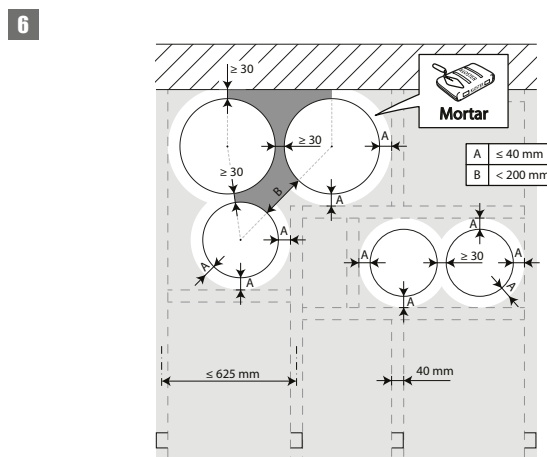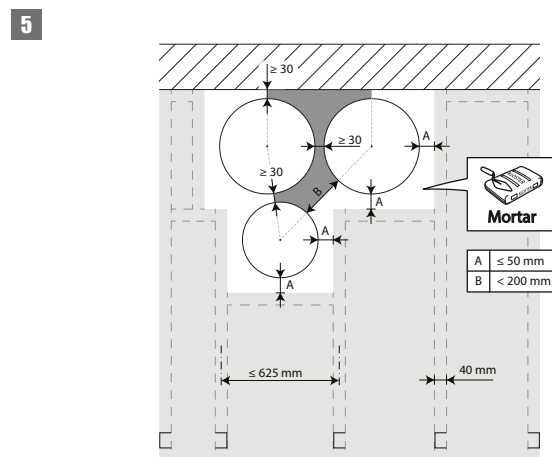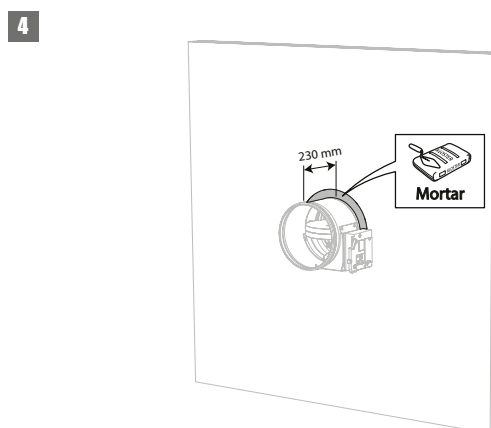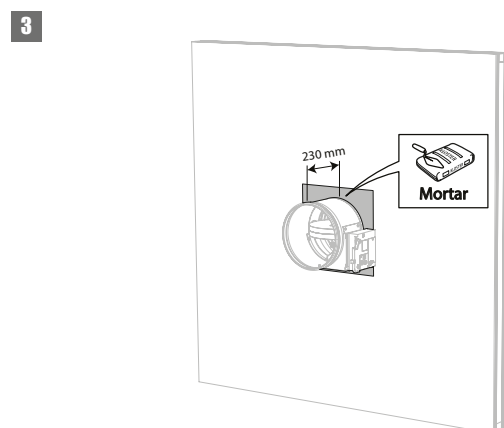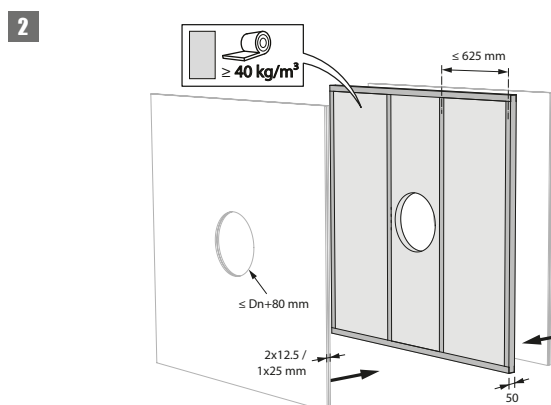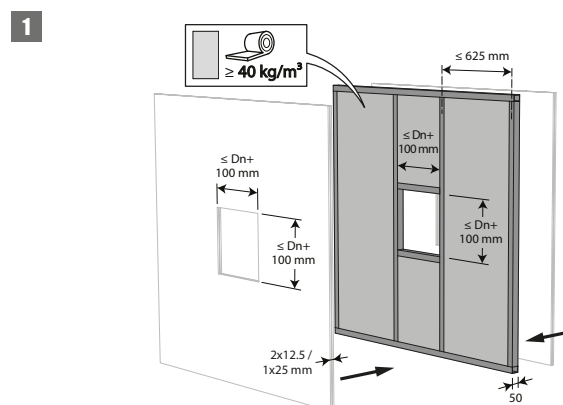

5. The dampers can be installed at a minimum distance ( $\geq 30$  mm) from an adjacent wall or from another damper.

7

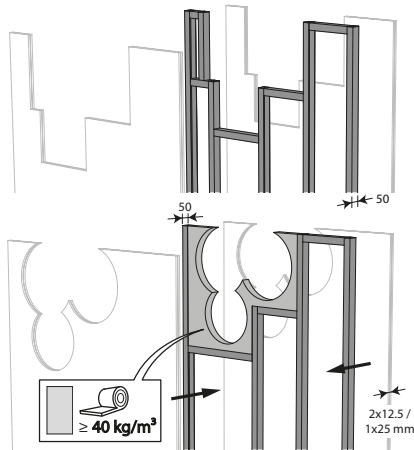


7. Build the drywall and mount horizontal and vertical studs around the opening.

When installing a single fire damper at a minimum distance from the ceiling, it is not necessary, from a fire technical point of view, to provide studs around the opening.

For a circular wall opening, the space between the plasterboard sheets is partially (up to  $D_n + 40$  mm) filled with stone wool with a minimum density of  $40 \text{ kg/m}^3$ .

8

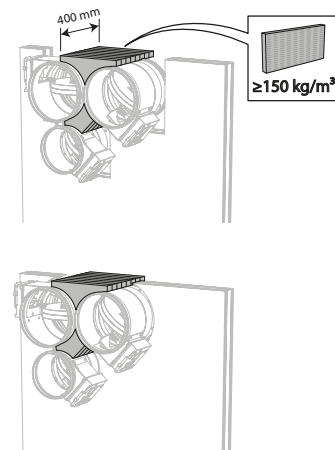


8. Mount the dampers in the opening.

Apply rigid stone wool panels ( $\geq 150 \text{ kg/m}^3$ ) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.

The surface of this sealing is set between the axes (centres) of the dampers.

- ⚠ Caution:** the opening is sealed according to the existing classification (see next point) when:
- 2 fire dampers are installed at a minimum distance from one another but at a normal distance ( $\geq 75$  mm) from the wall or floor/ceiling.
  - One single (no cluster) fire damper is located at a minimum distance ( $\leq 75$  mm) from a wall or floor/ceiling.

9

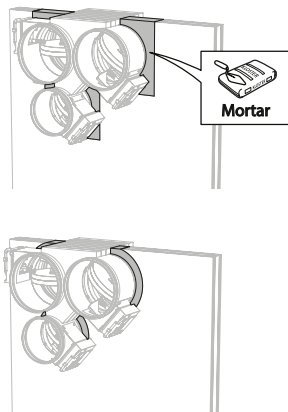


9. Seal the rest of the opening with standard mortar across the entire wall thickness.

## Installation in gypsum block wall


The product was tested and approved in:

Range	Wall type	Sealing	Classification
Ø 200-630 mm	Flexible wall	Gypsum blocks $\geq 70$ mm	Block glue
			El 120 ( $v_e i \leftrightarrow o$ ) S - (500 Pa)

1

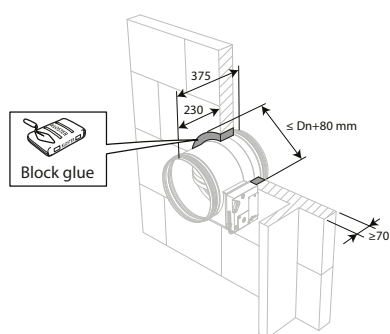


2




1. Seal the fire damper with a gypsum-based block glue.

3

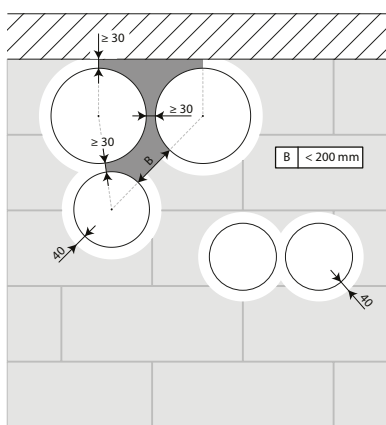


4

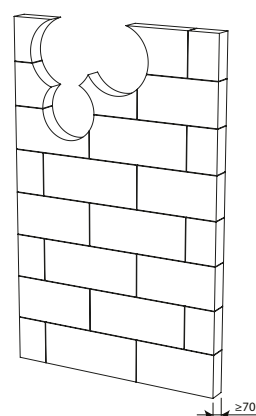

3. The dampers can be installed at a minimum distance from an adjacent wall or from another damper.

4. Make the necessary openings ( $\leq Dn + 80$  mm) in the wall.


5

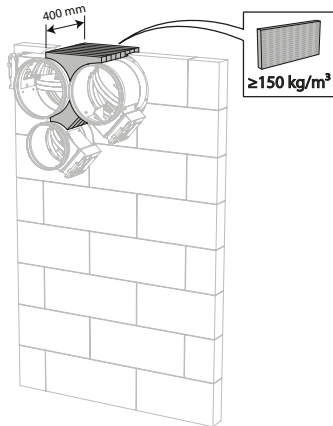

5. Mount the dampers in the opening.  
 Apply rigid stone wool panels ( $\geq 150 \text{ kg/m}^3$ ) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.  
 The surface of this sealing is set between the axes (centres) of the dampers.

- ⚠ Caution:** the opening is sealed according to the existing classification (see next point) when:
- 2 fire dampers are installed at a minimum distance from one another but at a normal distance ( $\geq 75 \text{ mm}$ ) from the wall or floor/ceiling.
  - One single (no cluster) fire damper is located at a minimum distance ( $\leq 75 \text{ mm}$ ) from a wall or floor/ceiling.

6

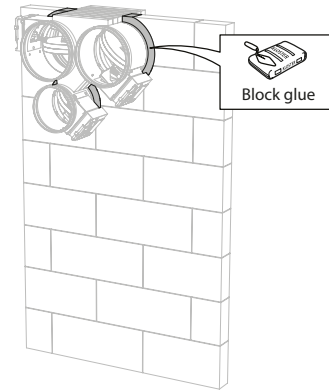


6. Seal the rest of the opening with block glue across the entire wall thickness.

## Installation in flexible and rigid wall, sealing with rigid stone wool boards with coating

The product was tested and approved in:


Range	Wall type	Sealing	Classification
Ø 200-630 mm	Rigid wall	Aerated concrete $\geq 100$ mm	Stone wool + coating $\geq 140$ kg/m <sup>3</sup>
Ø 200-630 mm	Rigid wall	Aerated concrete $\geq 100$ mm	Stone wool Mulcol Multimastic FB1 + coating
Ø 200-630 mm	Rigid wall	Aerated concrete $\geq 100$ mm	Stone wool Pyro-Safe® MFP + coating
Ø 200-630 mm	Flexible wall	Metal studs gypsum plasterboard Type A (EN 520) $\geq 100$ mm	Stone wool + coating $\geq 140$ kg/m <sup>3</sup>
Ø 200-630 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) $\geq 100$ mm	Stone wool + coating $\geq 140$ kg/m <sup>3</sup>
Ø 200-630 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) $\geq 100$ mm	Stone wool Mulcol Multimastic FB1 + coating
Ø 200-630 mm	Flexible wall	Metal studs gypsum plasterboard Type F (EN 520) $\geq 100$ mm	Stone wool Pyro-Safe® MFP + coating

1

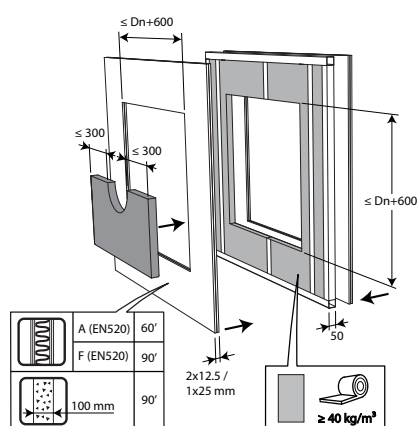


1. For flexible walls, provide horizontal and vertical studs around the opening. Exception: for fire resistance EI60S/EI90S and if sealing with Promastop or Hilti type boards, it is not necessary, from a fire technical point of view, to provide studs around the opening.

2

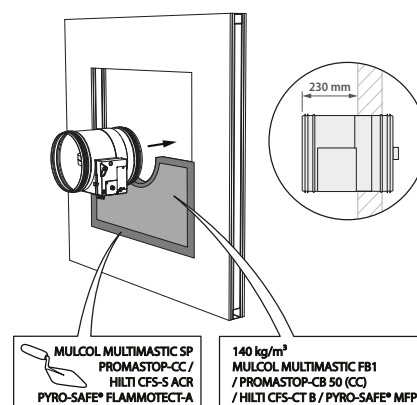


2. The opening around the damper is sealed with 2 layers of 50 mm-thick mineral wool panels with fire resistant coating on one side (type PROMASTOP-CB 50 / PROMASTOP-CB/CC 50 / HILTI CFS-CT B / Mulcol Multimastic FB1 / PYRO-SAFE® MFP).

3

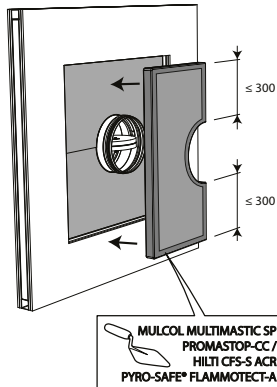


3. The joints on these 2 layers must be installed staggered and covered all around the edge with coating (type PROMASTOP-CC / HILTI CFS-S-ACR / Mulcol Multimastic SP / PYRO-SAFE® FLAMMOTECT-A).


4

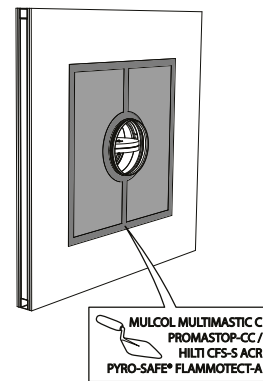


5

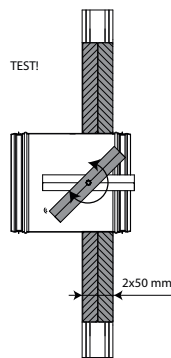

6

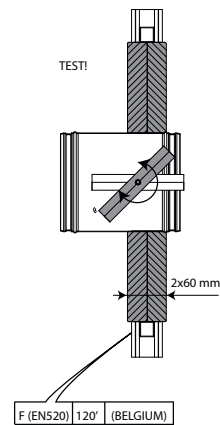


7

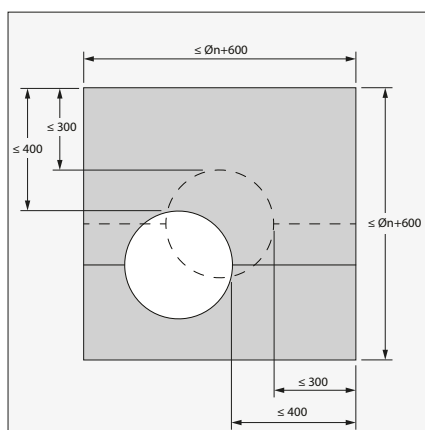

7. The damper does not need to be centered in the opening (with max dimensions fire damper + 600 mm). The maximal distance between the damper and the edge of the opening is 400 mm.


8

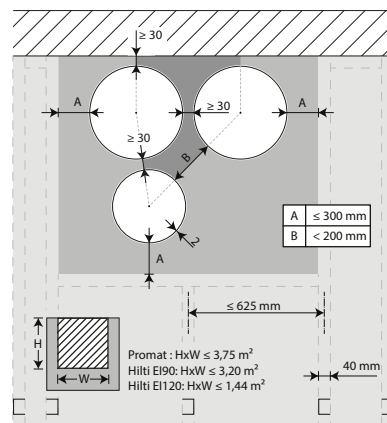


8. The dampers can be installed at a minimum distance ( $\geq 30$  mm) from an adjacent wall or from another damper.



9

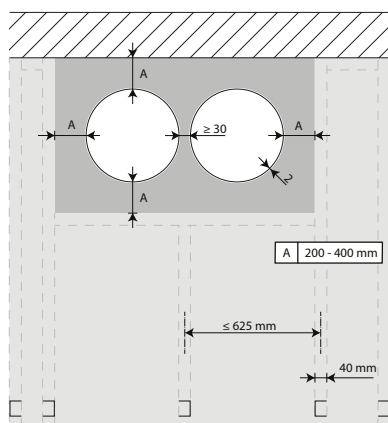

10

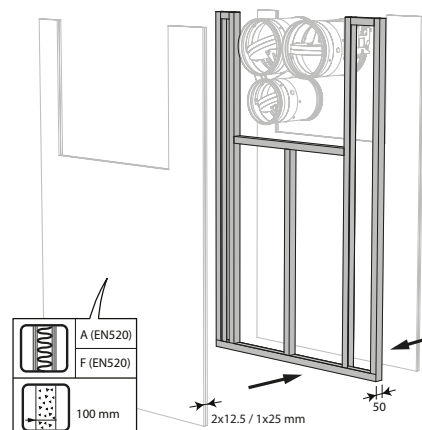


10. Build the drywall and mount horizontal and vertical studs around the opening.

When installing a single fire damper at a minimum distance from the ceiling, it is not necessary, from a fire technical point of view, to provide studs around the opening in case of desired fire resistance EI60S/EI90S.

Mount the dampers in the opening.


11

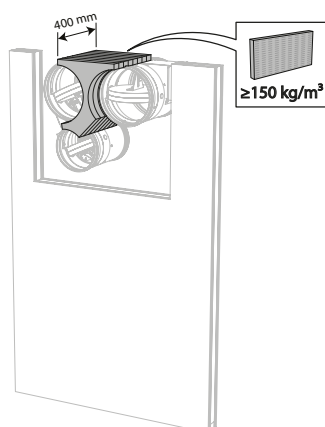

11. Apply rigid stone wool panels ( $\geq 150 \text{ kg/m}^3$ ) to a depth of 400 mm (150 mm on the mechanism side of the wall) to seal the opening at the side with minimal distances.


- ⚠ Caution:** the opening is sealed according to the existing classification (see next point) when:
- 2 fire dampers are installed at a minimum distance from one another but at a normal distance ( $\geq 75 \text{ mm}$ ) from the wall or floor/ceiling.
  - One single (no cluster) fire damper is located at a minimum distance ( $\leq 75 \text{ mm}$ ) from a wall or floor/ceiling.

12

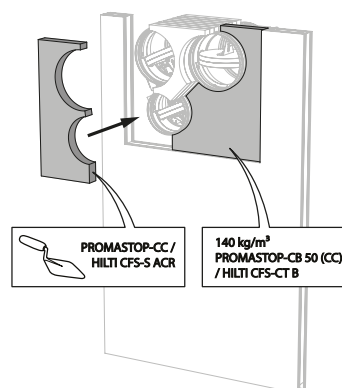

12. Seal the rest of the opening with 2 layers of 50 mm-thick coated rigid mineral wool panels (see above).

13

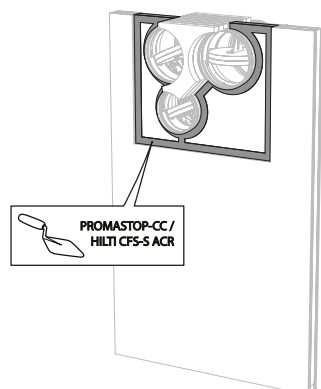


## Installation in rigid floor, sealing with rigid stone wool boards with coating


The product was tested and approved in:

Range	Wall type	Sealing	Classification
Ø 200-630 mm	Rigid floor	Aerated concrete ≥ 150 mm	Stone wool + coating ≥ 140 kg/m <sup>3</sup>
			El 120 (h <sub>0</sub> i ↔ o) S - (300 Pa)

1

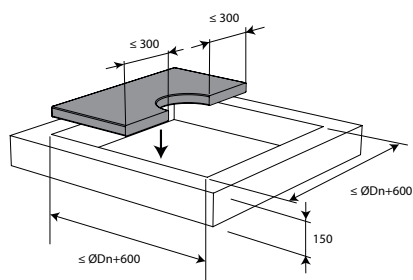


2

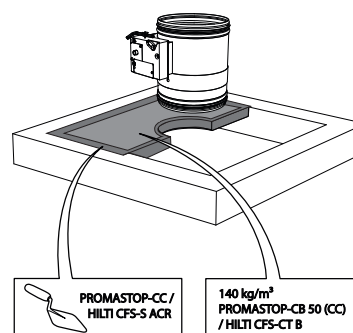


1. The opening around the damper is sealed with 2 layers of 50 mm-thick mineral wool panels with fire resistant coating on one side (type PROMASTOP-CB 50 / PROMASTOP-CB/CC 50 / HILTI CFS-CT B).

3

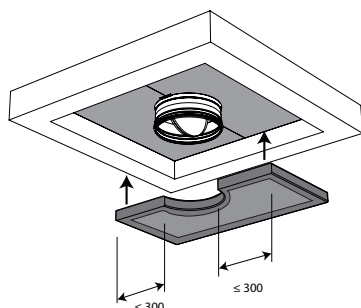


4

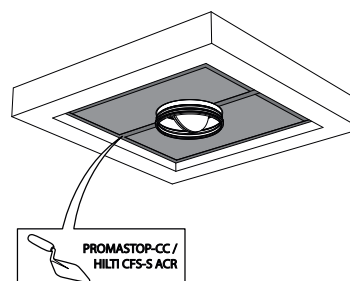


3. The joints on these 2 layers must be installed staggered and covered all around the edge with coating (type PROMASTOP-CC / HILTI CFS-S-ACR).

5

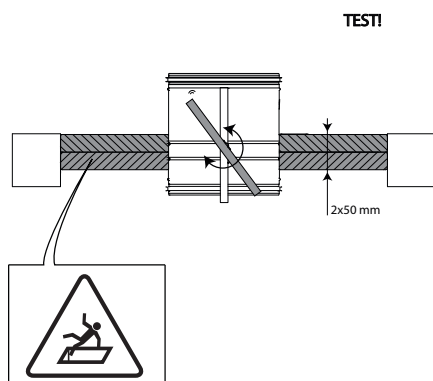


6

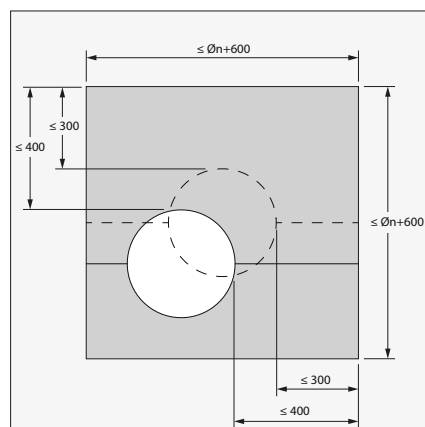

6. The damper does not need to be centered in the opening (with max dimensions fire damper + 600 mm). The maximal distance between the damper and the edge of the opening is 400 mm.

7

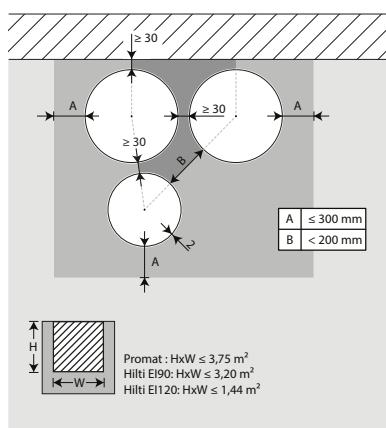

7. The dampers can be installed at a minimum distance ( $\geq 30$  mm) from an adjacent wall or from another damper. For details, please refer to 'Installation in flexible and rigid wall, sealing with rigid rock wool boards with coating'


## Inspection of the damper via UL option or via the fusible link opening of the ONE mechanism

1. An inspection opening (only available when ordering the 'UL' option) allows the position and condition of the damper to be visually determined with an endoscope. For fire dampers equipped with the ONE mechanism, it is also possible to carry out this camera inspection through the opening of the fusible link.
2. Insert the camera of the endoscope (for example Inspecam Rf-t) through the opening and inspect the inside of the damper.
3. After inspection, replace the air-tight plug thoroughly on the damper opening. The position is crucial in order to maintain the air-tightness of the fire damper.
4. ONE mechanism:  
Open the battery compartment.

Option UL:


Remove the air-tight plug from the damper.

5

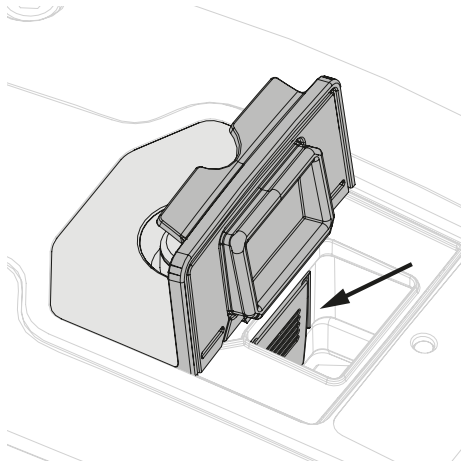

5. Press the flexible button inside the battery compartment.

6

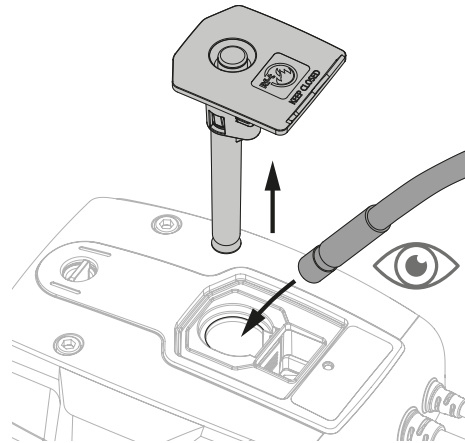

6. Pull the fusible link and the rubber cover simultaneously out of the mechanism.  
 Insert the camera of the endoscope (for example Inspectam Rf-t) through the opening and inspect the inside of the damper.  
 Slide the fusible link back into the mechanism until it clicks into place. Close the cover of the battery compartment.

## Maintenance

- No specific maintenance required.
- Schedule at least 2 visual checks each year.
- Remove dust and all other particles before use.
- Follow local maintenance regulations (i.e. BS9999 Annex V; NF S 61-933) and EN13306.
- Read the maintenance instructions on our website:  
[https://www.rft.eu/assets//PIM/DOCUMENTS/BROCHURE%20KITS/BRO\\_K139\\_MAINTENANCE\\_C.pdf](https://www.rft.eu/assets//PIM/DOCUMENTS/BROCHURE%20KITS/BRO_K139_MAINTENANCE_C.pdf)
- Use the damper at up to 95% humidity, non-condensing.
- The fire damper can be cleaned with a dry or slightly damp cloth. It is forbidden to use abrasive cleaners or mechanical cleaning techniques (brush).


## Operation and mechanisms



### CFTH Mechanism with fusible link

The unlocking mechanism CFTH automatically unlatches the damper blade when the temperature in the duct rises above 72°C. The damper can also be unlocked and reset manually.

1. unlocking button
2. resetting handle
3. cable entrance

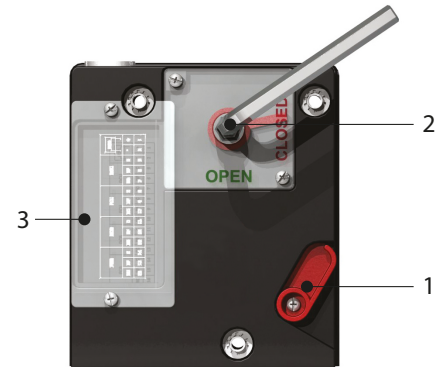

### Options - at the time of order

<b>FCU</b>	Limit switch 'closed'
<b>FDCU</b>	Unipolar limit switch 'open/closed'
<b>FDCB</b>	Bipolar auxiliary limit switch 'open/closed'

### Unlocking

- **manual unlocking:** use the unlocking button (1).
- **automatic unlocking:** when the fusible link melts at 72° C.
- **remote unlocking:** n/a

### Resetting

- **manual resetting:** use the enclosed Hex key and turn clockwise(2).
- **motorised resetting:** n/a

### Caution:


- ⚠ The mechanism may never be tested on its own, without being attached to the damper. Such a test might damage the mechanism or the operator might be injured.



## ONE Spring return actuator for remote control

The spring-return actuator ONE is designed to easily operate Rf-t fire dampers of all sizes, automatically or remotely. Six models are available, 24 or 230 volt, with FDCU or FDCB position switches; and optionally with plug (ST).

1. unlocking button
2. blade position indicator
3. LED
4. battery compartment to reset motor

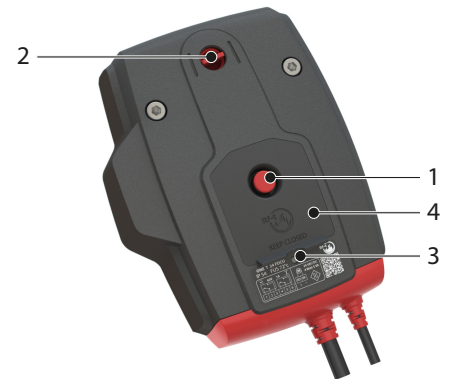

### Unlocking

- **manual unlocking:** shortly press the unlocking button (1) once.
- **automatic unlocking:** the fusible link reacts as soon as the temperature in the duct reaches 72°C.
- **remote unlocking:** by interrupting the power supply.

### Resetting

- **manual resetting:** open the battery compartment (4) and press a 9V battery against the contact springs. Hold this position until the LED (3) emits a continuous light.  
Check whether the indicator (2) shows that the damper blade is in the open position.  
Remove the battery, the LED fades away.  
Close the battery compartment.
- **motorised resetting:** switch off the power supply for at least 5 sec. Power the actuator (respect the prescribed voltage) for at least 75 sec. The resetting stops automatically when the end of range is reached (damper open).

### Caution:

- ⚠ If the LED (3) flickers fast (3x/sec.), the battery is discharged: use a new battery.
- ⚠ If the LED (3) flickers slowly (1x/sec), the resetting is in progress.
- ⚠ If the LED (3) is continuously on, the resetting is complete and the motor is powered.
- ⚠ If the actuator detects voltage on the power cable, a brief contact of the battery is enough to start the resetting process.
- ⚠ The power supply of this actuator cannot be individually replaced. If the cable is damaged, the whole unit must be discarded and replaced.
- ⚠ The housing of the mechanism contains a temperature sensor. When the temperature in the housing exceeds 72°C, the mechanism unlocks. The LED flashes twice per second. When the temperature drops below 72°C, the mechanism can only be reset in a motorised manner after a manual reset (with a battery).
- ⚠ The end of range switches need 1 second after operation to adopt a stable position.
- ⚠ Make sure the thermal trigger device is present in the actuator. The actuator might not function properly if this is not the case.

	prod. < 1/7/2015				prod. ≥ 1/7/2015			
	CR60(1s) CR120	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200	CR60(1s) CR120(1s)	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200
Kit ONE	●	●	●		●	●	●	●






## ONE-X Spring return actuator with integrated communication module.

The ONE-X is a spring return actuator with integrated communication module designed to simply operate Rf-t fire dampers of all sizes, automatically or remotely. The ONE-X is available in two versions: 24 V and 230 V.

1. unlocking button
2. blade position indicator
3. LED red: status
4. battery compartment
5. LED blue: communication
6. LED orange: error message
7. supply
8. bus cable

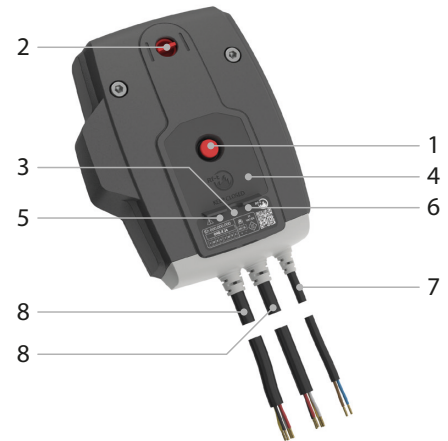

### Unlocking

- **manual unlocking:** shortly press the unlocking button (1) once.
- **automatic unlocking:** the fusible link reacts as soon as the temperature in the duct reaches 72°C.
- **remote unlocking:** via ZENiX controller

### Resetting

- **manual resetting:** Open the battery compartment (4) and press a 9V battery against the contact springs. Hold this position until the red LED (3) emits a continuous light. Control whether the indicator (2) indicates that the damper blade is open. Remove the battery. Close the battery compartment.
- **motorised resetting:** via ZENiX controller. By applying voltage during first use.

#### Caution:

- ⚠ If the ONE-X detects voltage on the power cable, a brief contact of the battery is enough to start the resetting process, provided the ZENiX controller has sent the damper to open position or the ONE-X is being operated for the first time.
- ⚠ The power supply of this actuator cannot be individually replaced. If the cable is damaged, the whole unit must be discarded and replaced.
- ⚠ The housing of the mechanism contains a temperature sensor. When the temperature in the housing exceeds 72°C, the mechanism unlocks. The LED flashes twice per second. When the temperature drops below 72°C, the mechanism can only be reset in a motorised manner after a manual reset (with a battery).
- ⚠ The end of range switches need 1 second after operation to adopt a stable position.

#### Safety regulations:


- ⚠ Do not use the ONE-X for any application other than the specified applications, in particular not in aircraft or other airborne vehicles.
- ⚠ The company that purchases and/or installs the ONE-X is fully responsible for the correct operation of the entire system. Only authorised specialists may perform the installation. All rules and regulations, including statutory regulations, must be observed during installation.
- ⚠ This device contains electrical or electronic components and must not be disposed of as household waste. All locally applicable regulations and requirements must be strictly observed.



## BFL(T) Remotely controlled spring return actuator

The spring return actuator BFL(T) is especially designed to operate fire dampers remotely. The BFL(T) variant is intended for fire dampers with smaller dimensions (CR60, CR120, CR2 with  $\varnothing \leq 400$  mm, CRS60 with  $\varnothing \leq 315$  mm, CU2 / CU2-15 / CU4 with  $W+H \leq 1200$  mm or for CU-LT and CU-LT-1s). For Markage FD with  $H = 200$  mm or  $H = 2200$  mm (in combination with BFT motor).

1. locking button
2. plug (ST)
3. access for manual resetting
4. thermo-electric tripping device (T)

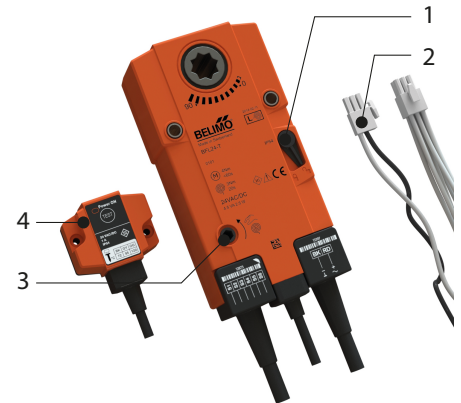

### Options - at the time of order

#### SN2 BFL/BFN

Auxiliary limit switch 'open/closed'

### Unlocking

- **manual unlocking:** place the locking button on "unlock". (In case of BFLT: the damper can alternatively be unlocked by pushing the "test" button on the thermo-electric fuse)
- **automatic unlocking:** the thermo-electric fuse reacts as soon as the temperature reaches 72°C (type BFLT).
- **remote unlocking:** by interrupting the power supply.

#### Caution:

- ⚠ The thermo-electric fuse will not move the damper into its safety position (when the temperature reaches 72°C) if the motor is not powered.

### Resetting

- **manual resetting:** turn the enclosed handle anti-clockwise. To block the motor, place the locking button on "lock"
- **motorised resetting:** switch off the power supply for at least 10 seconds. Supply the actuator (respect the prescribed voltage) for at least 75 seconds. The resetting stops automatically when the end of range is reached (damper open) - it takes about 60 seconds to reset the damper - or when the power supply is interrupted.

#### Caution:

- ⚠ Do not use a drill or powered screwdriver.
- ⚠ Stop as soon as the motor is completely rearmed (end of range).


	prod. < 1/7/2015				prod. ≥ 1/7/2015			
	CR60(1s) CR120	CU-LT CU-LT-1S	CR2≤400 CU2≤1200	CR2>400 CU2>1200	CR60(1s) CR120 (1s)	CU-LT CU-LT-1S	CR2≤400 CU2≤1200	CR2>400 CU2>1200
Kit BFL					•	•	•	
Kit BFN	•	•	•					•
Kit BF				•				



## BFN(T) Remotely controlled spring return actuator

The spring return actuator BFN(T) is especially designed to operate fire dampers remotely. The BFN(T) variant is intended for fire dampers with large dimensions (CRE60, CR2 with  $\varnothing > 400$  mm, CRS60 with  $\varnothing > 315$  mm or CU2, CU2-15, CU4 with  $W+H > 1200$  mm. For Markage FD with H of 400 and 600 mm or with H = 1200 mm (2 pcs) and with H = 2400 mm (in combination with BFT motor).

1. locking button
2. plug (ST)
3. access for manual resetting
4. thermo-electric tripping device (T)

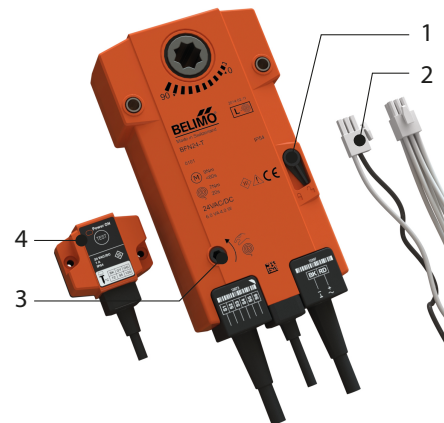

### Options - at the time of order

**SN2 BFL/BFN** Auxiliary limit switch 'open/closed'

### Unlocking

- **manual unlocking:** place the locking button on "unlock". (In case of BFNT: the damper can alternatively be unlocked by pushing the "test" button on the thermo-electric fuse)
- **automatic unlocking:** the thermo-electric fuse reacts as soon as the temperature reaches 72°C (type BFNT).
- **remote unlocking:** by interrupting the power supply.

#### Caution:

- ⚠ The thermo-electric fuse will not move the damper into its safety position (when the temperature reaches 72°C) if the motor is not powered.



### Resetting

- **manual resetting:** turn the enclosed handle anti-clockwise. To block the motor, place the locking button on "lock"
- **motorised resetting:** switch off the power supply for at least 10 seconds. Supply the actuator (respect the prescribed voltage) for at least 75 seconds. The resetting stops automatically when the end of range is reached (damper open) - it takes about 60 seconds to reset the damper - or when the power supply is interrupted.


#### Caution:

- ⚠ Do not use a drill or powered screwdriver.
- ⚠ Stop as soon as the motor is completely rearmed (end of range).

	prod. < 1/7/2015				prod. ≥ 1/7/2015			
	CR60(1s) CR120	CU-LT CU-LT-1S	CR2≤400 CU2≤1200	CR2>400 CU2>1200	CR60(1s) CR120 (1s)	CU-LT CU-LT-1S	CR2≤400 CU2≤1200	CR2>400 CU2>1200
Kit BFL					•	•	•	
Kit BFN	•	•	•					•
Kit BF				•				



## BFL(T)



DC : Switch open position fire damper  
FC : Switch closed position fire damper

MEC	Nominal voltage motor	Nominal voltage magnet	Power consumption (stand-by)	Power consumption (operating)	Standard switches	Resetting time motor	Running time spring
CFTH	N/A	N/A	N/A	N/A	1mA...6A, DC 5V...AC 250V	N/A	1 s
ONE T 24 FDCU	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W	1mA...1A 60VDC or 1mA...100mA 230VAC	< 75 s (cabled) / < 85 s (battery)	< 30 s
ONE T 24 FDCU ST	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W	1mA...1A 60VDC or 1mA...100mA 230VAC	< 75 s (cabled) / < 85 s (battery)	< 30 s
ONE T 230 FDCU	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W	1mA...1A 60VDC or 1mA...100mA 230VAC	< 75 s (cabled) / < 85 s (battery)	< 30 s
ONE T 230 FDCU ST	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W	1mA...1A 60VDC or 1mA...100mA 230VAC	< 75 s (cabled) / < 85 s (battery)	< 30 s
ONE T 24 FDCB	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W	1mA...1A 60VDC	< 75 s (cabled) / < 85 s (battery)	< 30 s
ONE T 230 FDCB	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W	1mA...1A 60VDC	< 75 s (cabled) / < 85 s (battery)	< 30 s
ONE-X 24	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W		< 75 s (cabled) / < 85 s (battery)	< 30 s
ONE-X 230	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W		< 75 s (cabled) / < 85 s (battery)	< 30 s
BFL24	24 V AC/DC	N/A	0,7 W	2,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFL24-ST	24 V AC/DC	N/A	0,7 W	2,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFL230	230 V AC	N/A	0,9 W	3 W	1mA...3A, AC 250V	< 60 s	20 s
BFLT24	24 V AC/DC	N/A	0,8 W	2,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFLT24-ST	24 V AC/DC	N/A	0,8 W	2,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFLT230	230 V AC	N/A	1,1 W	3,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFLT230-ST	230 V AC	N/A	1,1 W	3,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFN24	24 V AC/DC	N/A	1,4 W	4 W	1mA...3A, AC 250V	< 60 s	20 s
BFN24-ST	24 V AC/DC	N/A	1,4 W	4 W	1mA...3A, AC 250V	< 60 s	20 s
BFN230	230 V AC	N/A	2 W	4,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFNT24	24 V AC/DC	N/A	1,4 W	4 W	1mA...3A, AC 250V	< 60 s	20 s
BFNT24-ST	24 V AC/DC	N/A	1,4 W	4 W	1mA...3A, AC 250V	< 60 s	20 s
BFNT230	230 V AC	N/A	2,1 W	5 W	1mA...3A, AC 250V	< 60 s	20 s
BFNT230-ST	230 V AC	N/A	2,1 W	5 W	1mA...3A, AC 250V	< 60 s	20 s

MEC	Noise level motor	Noise level spring	Cable supply / control	Cable auxiliary switch	Protection class
CFTH	N/A	N/A			IP 42
ONE T 24 FDCU	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
ONE T 24 FDCU ST	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
ONE T 230 FDCU	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
ONE T 230 FDCU ST	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
ONE T 24 FDCB	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	(2x) 1 m, 6 x 0,75 mm <sup>2</sup> (halogen-free)	IP 54
ONE T 230 FDCB	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	(2x) 1 m, 6 x 0,75 mm <sup>2</sup> (halogen-free)	IP 54
ONE-X 24	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	bus cable: (2x) 1 m, 4 x 0,75 mm <sup>2</sup> (halogen-free)	IP 54
ONE-X 230	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	bus cable: (2x) 1 m, 4 x 0,75 mm <sup>2</sup> (halogen-free)	IP 54
BFL24	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFL24-ST	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFL230	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFLT24	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFLT24-ST	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFLT230	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFLT230-ST	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFN24	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFN24-ST	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFN230	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFNT24	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFNT24-ST	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFNT230	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54
BFNT230-ST	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm <sup>2</sup> (halogen-free)	1 m, 6 x 0.75 mm <sup>2</sup> (halogen-free)	IP 54

## Weights

## CR2 + CFTH

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	6,9	8,0	11,0	13,0	16,0	18,0	21,0	24,0	28,0	

## CR2 + ONE

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	7,7	8,8	11,8	13,8	16,8	18,8	21,8	24,8	28,8	

## CR2 + BFL

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	7,0	8,1	11,1	13,1	16,1	-	-	-	-	

## CR2 + BFLT

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	7,1	8,2	11,2	13,2	16,2	-	-	-	-	

## CR2 + BFN

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	-	-	-	-	-	18,4	21,4	24,4	28,4	

## CR2 + BFNT

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	-	-	-	-	-	18,5	21,5	24,5	28,5	

## CR2-L500 + CFTH

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	8,1	9,5	13,0	15,3	18,6	21,5	25,0	28,5	33,1	

## CR2-L500 + ONE

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	8,9	10,3	13,8	16,1	19,4	22,3	25,8	29,3	33,9	

## CR2-L500 + BFL

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	8,2	9,6	13,0	15,3	18,7	-	-	-	-	

## CR2-L500 + BFLT

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	8,3	9,7	13,1	15,4	18,8	-	-	-	-	

## CR2-L500 + BFN

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	-	-	-	-	-	21,9	25,3	28,8	33,5	

## CR2-L500 + BFNT

ØDn [mm]	200	250	315	355	400	450	500	560	630	
kg	-	-	-	-	-	22,0	25,4	28,9	33,6	

## Selection data

$$\Delta p \text{ [Pa]} = \zeta \cdot v^2 \cdot 0,6$$

ØDn [mm]	200	250	315	355	400	450	500	560	630	
$\zeta$ [-]	7,42	3,96	2,17	1,62	1,21	0,92	0,72	0,56	0,43	

## Example

### Data

Dn = 315 mm, v = 4 m/s

### Calculation

$$\Delta p = 2.17 \cdot (4 \text{ m/s})^2 \cdot 0.6 = 20.83 \text{ Pa}$$

## CR2 - A-weighted sound power level Lwa in the room

ØDn [mm]	200	250	315	355	400	450	500	560	630		
Sn [m²]	0,0129	0,0253	0,0472	0,0640	0,0859	0,1139	0,1459	0,1895	0,2474		
Sn [%]	41,54	51,89	60,94	64,99	68,67	71,94	74,60	77,19	79,62		
Q [m³/h]	363	674	1.250	1.710	2.332	3.159	4.137	5.523	7.446		
Δp [Pa]	45,88	34,57	25,84	22,39	19,29	16,80	14,80	13,03	11,36		45 dB
Q [m³/h]	301	560	1.038	1.420	1.936	2.622	3.434	4.585	6.182		
Δp [Pa]	31,62	23,82	17,81	15,43	13,29	11,58	10,20	8,98	7,83		40 dB
Q [m³/h]	250	465	861	1.179	1.607	2.177	2.851	3.806	5.132		
Δp [Pa]	21,79	16,42	12,27	10,63	9,16	7,98	7,03	6,19	5,39		35 dB
Q [m³/h]	208	386	715	978	1.334	1.807	2.367	3.160	4.260		
Δp [Pa]	15,02	11,31	8,46	7,33	6,31	5,50	4,84	4,27	3,72		30 dB
Q [m³/h]	172	320	594	812	1.107	1.500	1.965	2.623	3.536		
Δp [Pa]	10,35	7,80	5,83	5,05	4,35	3,79	3,34	2,94	2,56		25 dB

Every air flow lower than the above mentioned maximum value, will meet the listed A-weighted sound power level for the respective dimension. More information on sound power can be found in the product information on our website (documents).

## CR2-L500 - A-weighted sound power level Lwa in the room

ØDn [mm]	200	250	315	355	400	450	500	560	630		
Sn [m²]	0,0129	0,0253	0,0472	0,0640	0,0859	0,1139	0,1459	0,1895	0,2474		
Sn [%]	41,54	51,89	60,94	64,99	68,67	71,94	74,60	77,19	79,62		
Q [m³/h]	363	674	1.250	1.710	2.332	3.159	4.137	5.523	7.446		
Δp [Pa]	45,88	34,57	25,84	22,39	19,29	16,80	14,80	13,03	11,36		45 dB
Q [m³/h]	301	560	1.038	1.420	1.936	2.622	3.434	4.585	6.182		
Δp [Pa]	31,62	23,82	17,81	15,43	13,29	11,58	10,20	8,98	7,83		40 dB
Q [m³/h]	250	465	861	1.179	1.607	2.177	2.851	3.806	5.132		
Δp [Pa]	21,79	16,42	12,27	10,63	9,16	7,98	7,03	6,19	5,39		35 dB
Q [m³/h]	208	386	715	978	1.334	1.807	2.367	3.160	4.260		
Δp [Pa]	15,02	11,31	8,46	7,33	6,31	5,50	4,84	4,27	3,72		30 dB
Q [m³/h]	172	320	594	812	1.107	1.500	1.965	2.623	3.536		
Δp [Pa]	10,35	7,80	5,83	5,05	4,35	3,79	3,34	2,94	2,56		25 dB

Every air flow lower than the above mentioned maximum value, will meet the listed A-weighted sound power level for the respective dimension. More information on sound power can be found in the product information on our website (documents).

## Sample order

CR2	450	ONE T	24	FDCU
1	2	3	4	5

1. product
2. diameter
3. mechanism type
4. option: type voltage
5. option: uni/bipolar switches



## Approvals and certificates

All our dampers are submitted to a number of tests by official test institutes. Reports of these tests form the basis for the approvals of our dampers.



BCCA-0749-CPR-BC1-606-0464-15650.01-2517



18.14

NF 537  
CLAPETS RÉSISTANT AU FEU  
VOLETS RÉSISTANT AU FEU  
[www.marque-nf.com](http://www.marque-nf.com)



26814



2822-UKCA-CPR-0054

The NF-label guarantees: conformity with the standard NF S 61-937 Parts 1 and 5: "Systèmes de Sécurité Incendie Dispositifs Actionnés de Sécurité"; conformity with the national decree of March 22, 2004, changed on 14 March 2011 for the classification of fire resistance; the values of the characteristics mentioned in this document. Organisme Certificateur: AFNOR Certification, 11 Rue Francis de Pressensé, F93571 La Plaine Saint-Denis Cedex; Website: <http://www.afnor.org> and <http://www.marque-nf.com>; Phone: +33 (0)1.41.62.80.00, Fax: +33 (0)1.49.17.90.00, Email: [certification@afnor.org](mailto:certification@afnor.org)