

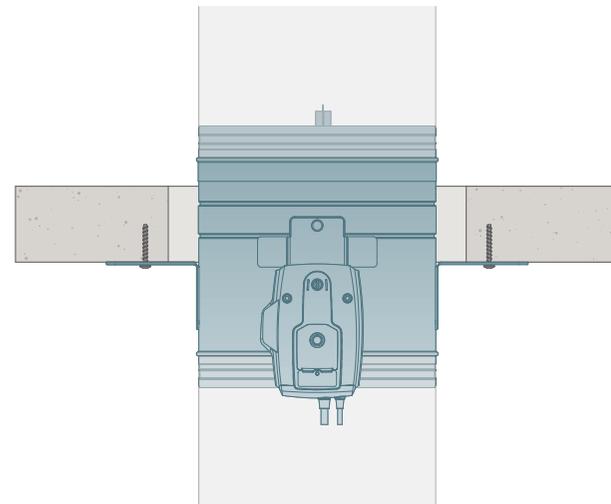
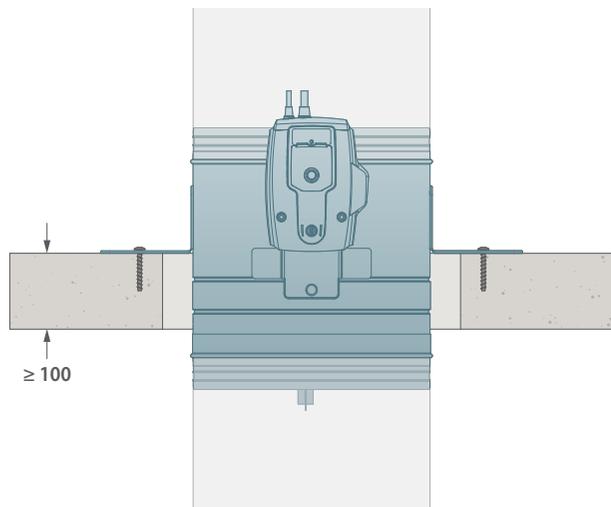


**CR60 FIRE DAMPER**

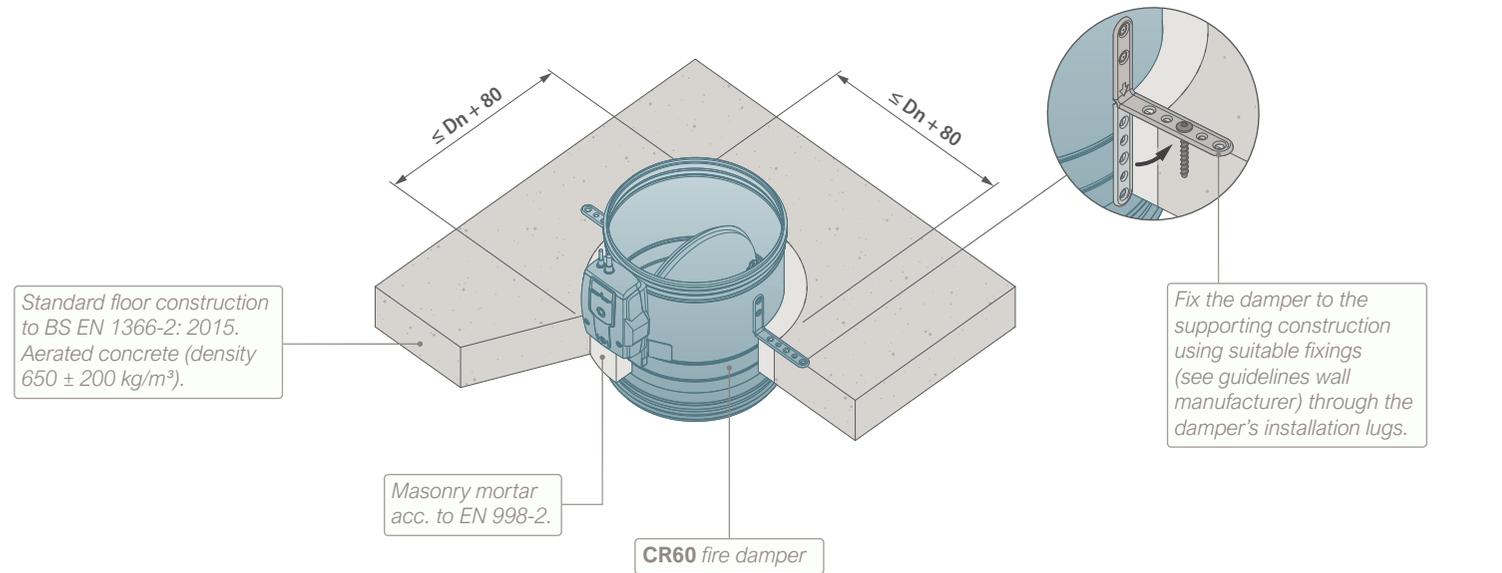

**TECHNICAL FEATURES**

- Damper range: ø100 till 315.
- Damper can be installed with mechanism on either side of the supporting construction (independent of fire side).
- A max. of 4 fire dampers can be installed at tested minimal distances from an adjacent vertical (supporting) construction or another fire damper. See detailed guidelines in the CR60 Technical Datasheet.

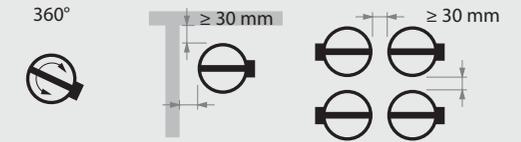

- To be read in conjunction with the CR60 Fire Damper Technical Datasheet.
- Guidelines acc. to DW144/145 (not required for CE):
  - 1 installation lug is included by default. A 2nd lug, as shown in the drawings, is available upon request.
  - Provide appropriate break-away / flexible joint between fire damper and connecting ductwork on both sides of the assembly (DW145: eg socket & spigot or flanged with appropriate fixings eg plastic cleats, clips, clamps, bolts, aluminium alloy rivets etc.).
  - Provide a panel in the adjacent ductwork to allow access to the internal components of the fire damper.
  - Ductwork must be independently supported and installed (DW144).
- Dimensions in mm unless otherwise stated.

**TECHNICAL DATASHEET**



**INSPECTION AND HANDOVER CHECK LIST**



**PLAN TITLE**

CR60 fire damper in rigid horizontal supporting construction  
Installation detail with mortar.

**CLASSIFICATION**

EI 60/90 (ho i↔o)S



**REV**  
A

**DATE**  
27/09/2023

