

CU2-15

Rectangular fire damper 120° at 1500 Pa



Table of content

Table of content

Declaration of performance	3
Product presentation CU2-15	4
Range and dimensions CU2-15	4
Variant CU2-15L	5
Range and dimensions CU2-15L	5
Evolution - kits	6
Options - at the time of order	9
Flange types - at the time of order	9
Storage and handling	11
Installation	11
Installation at a minimal distance from another damper or from an adjacent supporting construction	12
Installation in rigid wall	13
Operation and mechanisms	14
Electrical connection	19
Weights	21
Selection data	24
Example	25
Sample order	28
Approvals and certificates	28

Explanation of the abbreviations and pictograms

Wn = nominal width	E.TELE = power supply magnet	Sn = free air passage
Hn = nominal height	E.ALIM = power supply motor	ζ [-] = pressure loss coefficient
Dn = nominal diameter	V = volt	Q = airflow
E = integrity	W = watt	ΔP = static pressure drop
I = thermal insulation	Auto = automatic	v = air speed in the duct
S = smoke leakage	Tele = remote controlled	Lwa = A-weighted sound power level
Pa = pascal	Pnom = nominal capacity	Lw oct = sound power level per octave midband
ve = vertical wall penetration	Pmax = maximum capacity	dB(A) = A-weighted decibel value
ho = horizontal floor penetration	GKB (type A) / GKF (type F): "GKB"	ΔL = correction factor
o -> i = meets the criteria from the outside (o) to the inside (i)	stands for standard plasterboards (type A according to EN 520) while "GKF" plasterboards offer a higher fire resistance for a similar plate thickness (type F according to EN 520)	
i <-> o = fire side not important	Cal-Sil = calcium silicate	
V AC = Volt alternating current	OP = option (delivered with the product)	
V DC = Volt direct current	KIT = kit (delivered separately for repair or upgrade)	
	PG = connection flange to the duct	

	fire resistance tested at a negative pressure of 1500 Pa		suitable for built-in installation
	intermediate dimensions on request		

DECLARATION OF PERFORMANCE

UKCA_DOP_Rf-t_C7_EN ■ F-01/01/2024

UK
CADesignated standard
BS EN 15650:2010

Rf-t

Frank Verlinden, Head of Product Management
Oosterzele, 01/01/2024

1. Unique identification code of the product-type:
CU2-15
Rectangular fire damper to be used in conjunction with partitions to maintain fire compartments in heating, ventilating and air conditioning installations.

Rf-Technologies NV, Lange Ambachtstraat 40, B-9860 Oosterzele

System 1

BS EN 15650:2010, BCCA with identification number 0749; 2822-UKCA-CPR-0058

(Fire resistance according to BS EN 1366-2 and classifications according to BS EN 13501-3)

6. Dedicated performance according to BS EN 15650:2010

Essential characteristics

Range	Type	Wall	Sealing	Performance	
				Installation	Classification
200x200 mm ≤ CU2-15 ≤ 1200x800 mm	Rigid wall	Reinforced concrete ≥ 110 mm	Mortar	1	EI 120 (v _e i ↔ o) S - (1500 Pa)
1	Type of installation: built-in 0 / 180°				

Nominal activation conditions/sensitivity:	Pass	Integrity (E)	120 minutes
Response delay (response time); closure time	Pass	Insulation (E)	120 minutes
Operational reliability; cycling	CFTH - 50 cycles; MANO - 300 cycles; BFL(T) - 10000 cycles; BN(T) - 10000 cycles; ONE - 10000 cycles; UNQ - 10000 cycles	Smoke leakage (E/S)	120 minutes
Durability of response delay;	Pass	Mechanical stability (under E)	Pass
Durability of operational reliability:	Pass	Maintenance of cross section (under E)	Pass
Protection against corrosion according to EN 60068-2-52:	Pass		
Damper casing leakage according to EN 1751:	≥ class B		

The performance of the product identified above is in conformity with the set of declared performance/s. This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.

4 Product presentation CU2-15

Product presentation CU2-15

Rectangular fire damper with a 120 minutes fire resistance in concrete walls with air pressure up to 1500 Pascal. Its refractory casing is made of asbestos free panels, which are resistant to humidity.


Fire dampers are installed where air ducts penetrate fire-resistant compartment walls. Their role is to restore the fire resistance grade of the penetrated wall and to prevent smoke propagation. Fire dampers are distinguished by their degree of fire resistance, by their aerodynamic properties as well as by their installation ease. Rf-Technologies' fire dampers are all CE marked. They can be equipped with various types of mechanisms depending on the specific needs linked to the project or to the local regulations.

- fire resistance tested at a negative pressure of 1500 Pa




- suitable for built-in installation
- air tightness in accordance with EN 1751: class B (class C in option)
- tested in accordance with EN1366-2 up to 1500 Pa
- operating mechanism outside the wall
- maintenance-free
- for indoor use
- operating temperature: max. 50°C
- intermediate dimensions on request
- suitable for installation in rigid wall

1. connection flange PG30
2. casing made of refractory material
3. damper blade
4. operating mechanism
5. sealing cold smoke
6. blade bumper
7. intumescence strip
8. transmission with locking (open/closed)
9. fusible link
10. product identification

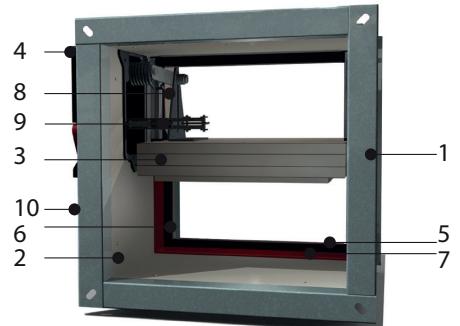

Range and dimensions CU2-15

Wn/Hn in steps of 50 mm; intermediate dimensions are subject to extra cost (heights between ≥ 275 and ≤ 299 mm are not possible). Exceeding blade: X = on the mechanism side, Y = on the wall side

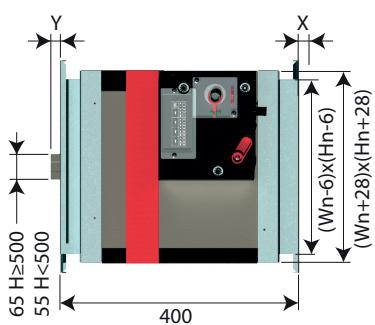

Hn [mm]	300	350	400	450	500	550	600	650	700	750	800
x	-	-	-	-	-	-	25	50	75	100	125
y	1	26	51	51	101	126	151	176	201	226	251


(W x H) mm \geq \leq
200x200 1200x800

Variant CU2-15L


Damper with a tunnel casing extension at one or both sides so that the damper blade does not exceed the tunnel. This version allows to connect a grill or a bend directly on the damper flange or to use a circular connection.

Range and dimensions CU2-15L

Wn/Hn in steps of 50 mm; intermediate dimensions are subject to extra cost (heights between ≥ 275 and ≤ 299 mm are not possible). Exceeding blade: X = on the mechanism side, Y = on the wall side

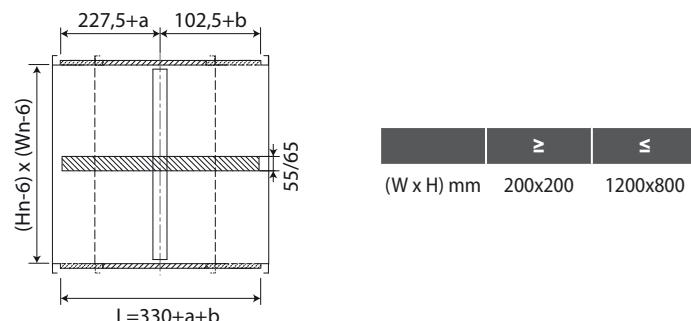

Hn < 300 mm **Hn \geq 300 mm**

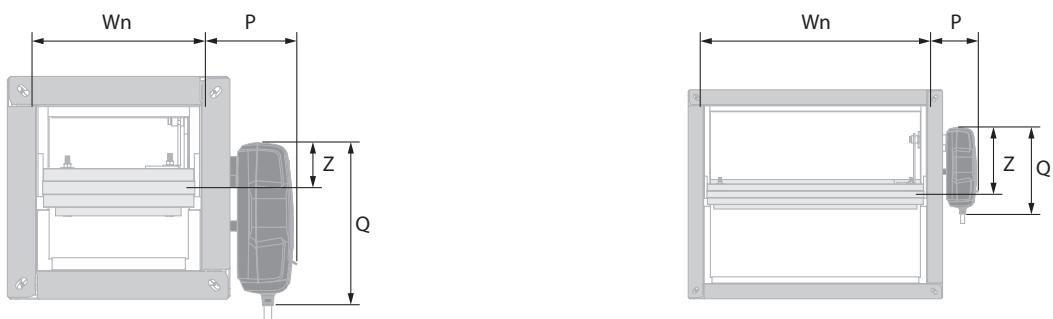

	CFTH	ONE (X)	BFL(T)		CFTH	ONE (X)	BFL(T)	BFN(T)
P	78	104	96		P	78	104	100
Q	180	191	110		Q	180	191	110
Z	62	47	74		Z	157	147	180

Evolution - kits

Evolution - kits



KIT ONE T 24 FDCB	Spring return actuator ONE 24V (with fusible link T) + bipolar beginning- and end-of-range switch
KIT ONE T 24 FDCU	Spring return actuator ONE 24V (with fusible link T) + unipolar beginning- and end-of-range switch
KIT ONE T 24 FDCU ST	Spring return actuator ONE 24V (with fusible link T) + unipolar beginning- and end-of-range switch + plug (ST)
KIT ONE T 230 FDDB	Spring return actuator ONE 230V (with fusible link T) + bipolar beginning- and end-of-range switch
KIT ONE T 230 FDCU	Spring return actuator ONE 230V (with fusible link T) + unipolar beginning- and end-of-range switch
KIT ONE T 230 FDCU ST	Spring return actuator ONE 230V (with fusible link T) + unipolar beginning- and end-of-range switch + plug (ST)
KIT ONE-X 24	Spring return actuator ONE-X 24V (with fusible link T)
KIT ONE-X 230	Spring return actuator ONE-X 230V (with fusible link T)
KIT CFTH	Automatic unlocking mechanism CFTH with FCU and without FTH 72



KIT BFL24	Spring return actuator BFL 24V
KIT BFL24-ST	Spring return actuator BFL 24V with plug (ST)
KIT BFL230	Spring return actuator BFL 230V
KIT BFLT24	Spring return actuator BFL 24V with thermo-electric fuse (T)
KIT BFLT24-ST	Spring return actuator BFL 24V with thermo-electric fuse (T) and plug (ST)
KIT BFLT230	Spring return actuator BFL 230V with thermo-electric fuse (T)
KIT BFLT230-ST	Spring return actuator BFL 230V with thermo-electric fuse (T)
KIT BFN24	Spring return actuator BFN 24V
KIT BFN24-ST	Spring return actuator BFN 24V with plug (ST)

Evolution - kits



KIT BFN24

Spring return actuator BFN 24V (BFN kits must be used instead of BFL kits for fire dampers produced before 1/7/2015)



KIT BFN230

Spring return actuator BFN 230V



KIT BFNT24

Spring return actuator BFN 24V with thermo-electric fuse (T)



KIT BFNT24-ST

Spring return actuator BFN 24V with thermo-electric fuse (T) and plug (ST)



KIT BFNT230

Spring return actuator BFN 230V with thermo-electric fuse (T)



KIT BFNT230-ST

Spring return actuator BFN 230V with thermo-electric fuse (T)



KIT BF24

Spring return actuator BF 24V (BF kits must be used instead of BFN kits for fire dampers produced before 1/7/2015)



KIT FDC CFTH

1 limit switch (FCU/DCU/FCB/DCB)



KIT SN2 BFL/BFN

Auxiliary limit switch 'open/closed'



KIT FTH72

Fusible link FTH 72°C (for CFTH)



KIT ZBAT 72

Black spare part for thermo-electric fuse for BFLT/BFNT



FUS72 ONE

Fusible link 72°C



MECT

Testbox for mechanisms 24/48 V (magnet, motor, beginning and end of range switches)




Options - at the time of order



EN1751_C




Air-tightness class C

Flange types - at the time of order



PG30


Connection to ducts with 30 mm flanges (either by sliding profile, or with bolts, or with clamps). Elliptical holes Ø 8,5 x 16 mm.




PG40

Connection to ducts with 40 mm flanges (either by sliding profile, or with bolts, or with clamps). Elliptical holes Ø 8,5 x 16 mm.


Flange types - at the time of order

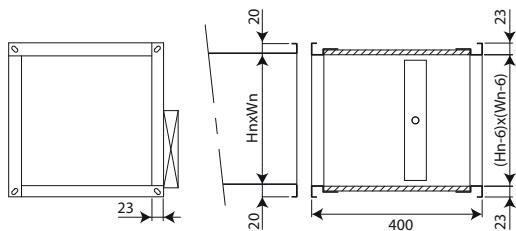**PG20**


Connection to ducts with 20 mm flanges (either by sliding profile, or with bolts, or with clamps). Elliptical holes Ø 6,5 x 16 mm.

**PM**


Connection to ducts by insertion. This type of frame is used in case of lack of space for a standard PG30 frame.

**PP**

No connection. This type of frame is used on one side of a damper that ends into a room.

**PRJ**

Circular connection with rubber sealing ring.

**PPT**

Grill. Very well suited as protection grill on the end piece of a duct system.

Storage and handling

As this product is a safety element, it should be stored and handled with care.

Avoid:

- any kind of impact or damage
- contact with water
- deformation of the casing



It is recommended:

- to unload in a dry area
- not to flip or roll the product to move it
- not to use the damper as a scaffold, working table, etc.
- not to store smaller dampers inside larger ones

Installation

General points


- The installation must comply with the installation manual and the classification report.
- Axis orientation: see the declaration of performance.
- Avoid obstruction of adjoining ducts.
- Product installation: always with closed damper blade.
- Verify if the blade can move freely.
- Please observe safety distances with respect to other construction elements. The operating mechanism must also remain accessible: allow for a clearance of 200 mm around the housing.
- The air tightness class will be maintained if the damper is installed according to the installation manual.
- Rf-t fire dampers are always tested in standardised constructions according to EN 1366-2. The achieved results are valid for similar supporting constructions with a fire resistance, thickness and density equal or superior to the supporting construction used during the test.
- If the wall thickness exceeds the minimum thickness specified in our installation instructions, the following conditions apply to the sealing depth:
 - For flexible walls and sandwich panel system walls, the seal must always be applied over the full depth of the wall.
 - With rigid walls, rigid floors and plaster block walls, the minimum sealing depth as indicated in our installation instructions (often equal to the minimum wall thickness) is sufficient. Apply the seal at the height of the damper blade (from the wall limit indication).
- When installing a fire damper in a flexible metal stud wall, some installation methods do not require reinforcing profiles around the wall opening from a fire protection point of view (see below). Always follow the general instructions of the manufacturer of these wall systems when building this type of wall.
- The damper must remain accessible for inspection and maintenance.
- Schedule at least 2 visual checks each year.



Installation

Installation at a minimal distance from another damper or from an adjacent supporting construction

1

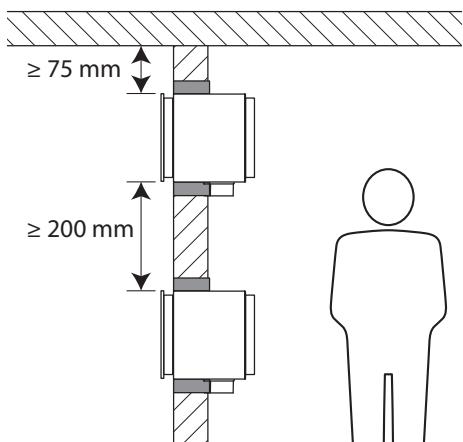

1. Principle


According to the European test standard, a fire damper must be installed at a minimum distance of 75 mm from an adjacent wall and 200 mm from another damper, unless the solution was tested at a shorter distance.

Installation in rigid wall


The product was tested and approved in:

Range	Wall type	Sealing	Classification	
200x200 mm ≤ CU2-15 ≤ 1200x800 mm	Rigid wall	Reinforced concrete ≥ 110 mm	Mortar	El 120 (v_e i ↔ o) S - (1500 Pa)


1

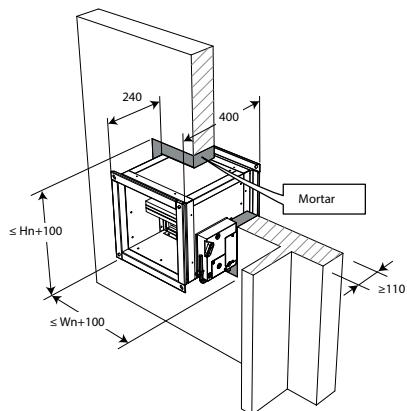

2

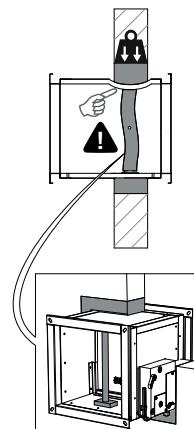

3



Maintenance

- No specific maintenance required.
- Schedule at least 2 visual checks each year.
- Remove dust and all other particles before use.
- Follow local maintenance regulations (i.e. BS9999 Annex V; NF S 61-933) and EN13306.
- Read the maintenance instructions on our website:
https://www.rft.eu/assets//PIM/DOCUMENTS/BROCHURE%20KITS/BRO_K139_MAINTENANCE_C.pdf
- Use the damper at up to 95% humidity, non-condensing.
- The fire damper can be cleaned with a dry or slightly damp cloth. It is forbidden to use abrasive cleaners or mechanical cleaning techniques (brush).

Operation and mechanisms


Operation and mechanisms



CFTH Mechanism with fusible link

The unlocking mechanism CFTH automatically unlatches the damper blade when the temperature in the duct rises above 72°C. The damper can also be unlocked and reset manually.

1. unlocking button
2. resetting handle
3. cable entrance

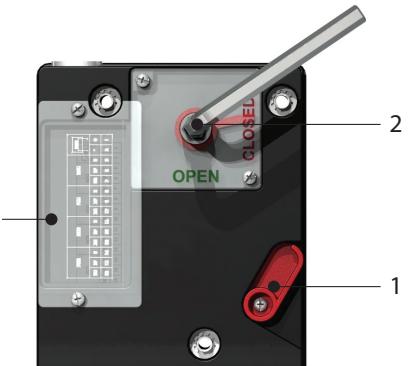

Options - at the time of order

FCU	Limit switch 'closed'
FDCU	Unipolar limit switch 'open/closed'
FDCB	Bipolar auxiliary limit switch 'open/closed'

Unlocking

- **manual unlocking:** use the unlocking button (1).
- **automatic unlocking:** when the fusible link melts at 72° C.
- **remote unlocking:** n/a

Resetting

- **manual resetting:** use the enclosed Hex key and turn clockwise(2).
- **motorised resetting:** n/a

Caution:

⚠ The mechanism may never be tested on its own, without being attached to the damper. Such a test might damage the mechanism or the operator might be injured.



ONE Spring return actuator for remote control

The spring-return actuator ONE is designed to easily operate Rf-t fire dampers of all sizes, automatically or remotely. Six models are available, 24 or 230 volt, with FDCU or FDCB position switches; and optionally with plug (ST).

1. unlocking button
2. blade position indicator
3. LED
4. battery compartment to reset motor



Unlocking

- **manual unlocking:** shortly press the unlocking button (1) once.
- **automatic unlocking:** the fusible link reacts as soon as the temperature in the duct reaches 72°C.
- **remote unlocking:** by interrupting the power supply.

Resetting

- **manual resetting:** open the battery compartment (4) and press a 9V battery against the contact springs. Hold this position until the LED (3) emits a continuous light.
Check whether the indicator (2) shows that the damper blade is in the open position.
Remove the battery, the LED fades away.
Close the battery compartment.
- **motorised resetting:** switch off the power supply for at least 5 sec. Power the actuator (respect the prescribed voltage) for at least 75 sec. The resetting stops automatically when the end of range is reached (damper open).

Caution:

- ⚠ If the LED (3) flickers fast (3x/sec.), the battery is discharged: use a new battery.
- ⚠ If the LED (3) flickers slowly (1x/sec), the resetting is in progress.
- ⚠ If the LED (3) is continuously on, the resetting is complete and the motor is powered.
- ⚠ If the actuator detects voltage on the power cable, a brief contact of the battery is enough to start the resetting process.
- ⚠ The power supply of this actuator cannot be individually replaced. If the cable is damaged, the whole unit must be discarded and replaced.
- ⚠ The housing of the mechanism contains a temperature sensor. When the temperature in the housing exceeds 72°C, the mechanism unlocks. The LED flashes twice per second. When the temperature drops below 72°C, the mechanism can only be reset in a motorised manner after a manual reset (with a battery).
- ⚠ The end of range switches need 1 second after operation to adopt a stable position.
- ⚠ Make sure the thermal trigger device is present in the actuator. The actuator might not function properly if this is not the case.

	prod. < 1/7/2015				prod. ≥ 1/7/2015			
	CR60(1s) CR120	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200	CR60(1s) CR120(1s)	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200
Kit ONE	●	●	●		●	●	●	●


Operation and mechanisms



ONE-X Spring return actuator with integrated communication module.

The ONE-X is a spring return actuator with integrated communication module designed to simply operate Rf-t fire dampers of all sizes, automatically or remotely. The ONE-X is available in two versions: 24 V and 230 V.

1. unlocking button
2. blade position indicator
3. LED red: status
4. battery compartment
5. LED blue: communication
6. LED orange: error message
7. supply
8. bus cable

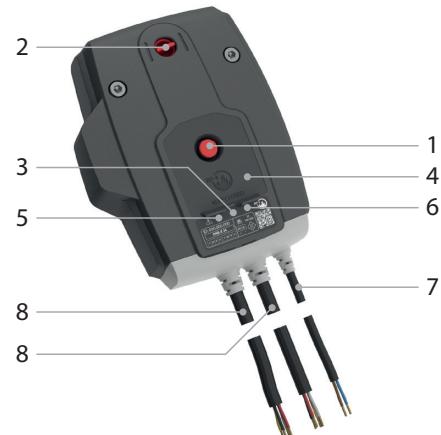

Unlocking

- **manual unlocking:** shortly press the unlocking button (1) once.
- **automatic unlocking:** the fusible link reacts as soon as the temperature in the duct reaches 72°C.
- **remote unlocking:** via ZENiX controller

Resetting

- **manual resetting:** Open the battery compartment (4) and press a 9V battery against the contact springs. Hold this position until the red LED (3) emits a continuous light. Control whether the indicator (2) indicates that the damper blade is open. Remove the battery. Close the battery compartment.
- **motorised resetting:** via ZENiX controller. By applying voltage during first use.

Caution:

- ⚠ If the ONE-X detects voltage on the power cable, a brief contact of the battery is enough to start the resetting process, provided the ZENiX controller has sent the damper to open position or the ONE-X is being operated for the first time.
- ⚠ The power supply of this actuator cannot be individually replaced. If the cable is damaged, the whole unit must be discarded and replaced.
- ⚠ The housing of the mechanism contains a temperature sensor. When the temperature in the housing exceeds 72°C, the mechanism unlocks. The LED flashes twice per second. When the temperature drops below 72°C, the mechanism can only be reset in a motorised manner after a manual reset (with a battery).
- ⚠ The end of range switches need 1 second after operation to adopt a stable position.

Safety regulations:

- ⚠ Do not use the ONE-X for any application other than the specified applications, in particular not in aircraft or other airborne vehicles.
- ⚠ The company that purchases and/or installs the ONE-X is fully responsible for the correct operation of the entire system. Only authorised specialists may perform the installation. All rules and regulations, including statutory regulations, must be observed during installation.
- ⚠ This device contains electrical or electronic components and must not be disposed of as household waste. All locally applicable regulations and requirements must be strictly observed.



BFL(T) Remotely controlled spring return actuator

The spring return actuator BFL(T) is especially designed to operate fire dampers remotely. The BFL(T) variant is intended for fire dampers with smaller dimensions (CR60, CR120, CR2 with $\varnothing \leq 400$ mm, CRS60 with $\varnothing \leq 315$ mm, CU2 / CU2-15 / CU4 with $B+H \leq 1200$ mm or for CU-LT and CU-LT-1s). For Markage FD with $H = 200$ mm or $H = 2200$ mm (in combination with BFT motor).

1. locking button
2. plug (ST)
3. access for manual resetting
4. thermo-electric tripping device (T)



Options - at the time of order

SN2 BFL/BFN Auxiliary limit switch 'open/closed'

Unlocking

- **manual unlocking:** place the locking button on "unlock". (In case of BFLT: the damper can alternatively be unlocked by pushing the "test" button on the thermo-electric fuse)
- **automatic unlocking:** the thermo-electric fuse reacts as soon as the temperature reaches 72°C (type BFLT).
- **remote unlocking:** by interrupting the power supply.

Caution:

⚠ The thermo-electric fuse will not move the damper into its safety position (when the temperature reaches 72°C) if the motor is not powered.

Resetting

- **manual resetting:** turn the enclosed handle anti-clockwise. To block the motor, place the locking button on "lock"
- **motorised resetting:** switch off the power supply for at least 10 seconds. Supply the actuator (respect the prescribed voltage) for at least 75 seconds. The resetting stops automatically when the end of range is reached (damper open) - it takes about 60 seconds to reset the damper - or when the power supply is interrupted.

Caution:

⚠ Do not use a drill or powered screwdriver.
⚠ Stop as soon as the motor is completely rearmed (end of range).

	prod. < 1/7/2015				prod. ≥ 1/7/2015			
	CR60(1s) CR120	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200	CR60(1s) CR120 (1s)	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200
Kit BFL					●	●	●	
Kit BFN	●	●	●					●
Kit BF				●				

Operation and mechanisms



BFN(T) Remotely controlled spring return actuator

The spring return actuator BFN(T) is especially designed to operate fire dampers remotely. The BFN(T) variant is intended for fire dampers with large dimensions (CRE60, CR2 with $\varnothing > 400$ mm, CRS60 with $\varnothing > 315$ mm or CU2, CU2-15, CU4 with $B+H > 1200$ mm). For Markage FD with H of 400 and 600 mm or with H = 1200 mm (2 pcs) and with H = 2400 mm (in combination with BFT motor).

1. locking button
2. plug (ST)
3. access for manual resetting
4. thermo-electric tripping device (T)



Options - at the time of order

SN2 BFL/BFN Auxiliary limit switch 'open/closed'

Unlocking

- **manual unlocking:** place the locking button on "unlock". (In case of BFNT: the damper can alternatively be unlocked by pushing the "test" button on the thermo-electric fuse)
- **automatic unlocking:** the thermo-electric fuse reacts as soon as the temperature reaches 72°C (type BFNT).
- **remote unlocking:** by interrupting the power supply.

Caution:

⚠ The thermo-electric fuse will not move the damper into its safety position (when the temperature reaches 72°C) if the motor is not powered.

Resetting






- **manual resetting:** turn the enclosed handle anti-clockwise. To block the motor, place the locking button on "lock"
- **motorised resetting:** switch off the power supply for at least 10 seconds. Supply the actuator (respect the prescribed voltage) for at least 75 seconds. The resetting stops automatically when the end of range is reached (damper open) - it takes about 60 seconds to reset the damper - or when the power supply is interrupted.

Caution:

⚠ Do not use a drill or powered screwdriver.
⚠ Stop as soon as the motor is completely rearmed (end of range).

	prod. < 1/7/2015				prod. ≥ 1/7/2015			
	CR60(1s) CR120	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200	CR60(1s) CR120 (1s)	CU-LT CU-LT-1s	CR2≤400 CU2≤1200	CR2>400 CU2>1200
Kit BFL					●	●	●	
Kit BFN	●	●	●					●
Kit BF				●				

Electrical connection

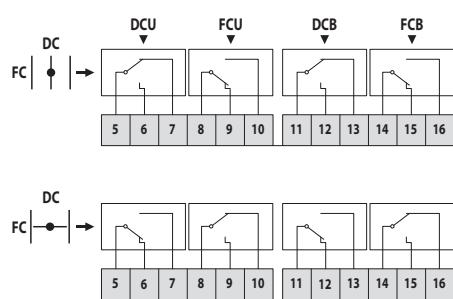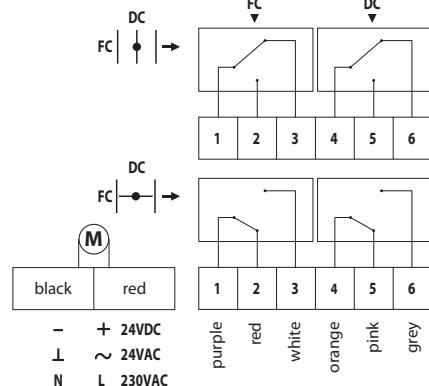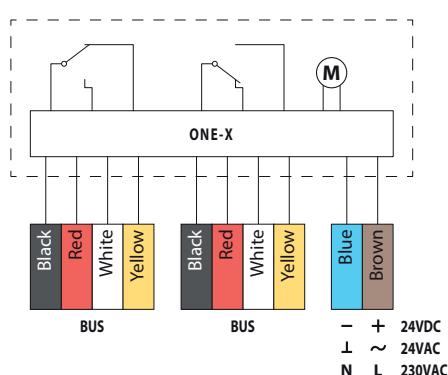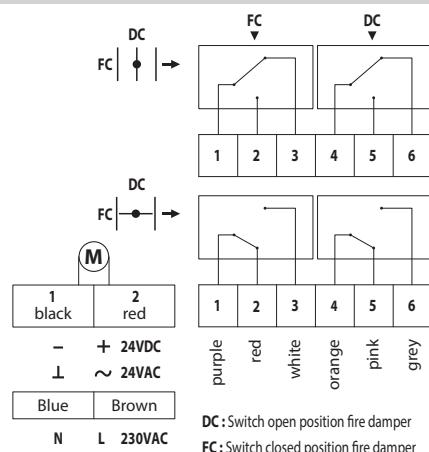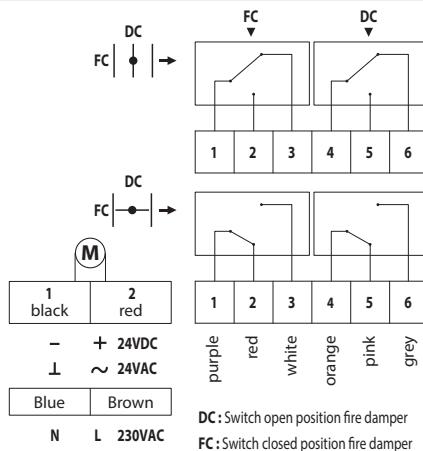CFTH

ONE

ONE-X

BFL(T)

BFN(T)


Electrical connection

MEC	Nominal voltage motor	Nominal voltage magnet	Power consumption (stand-by)	Power consumption (operating)	Standard switches	Resetting time motor	Running time spring
CFTH	N/A	N/A	N/A	N/A	1mA...6A, DC 5V...AC 250V	N/A	1 s
ONE T 24 FDCU	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W	1mA...1A 60V	< 75 s (cabled) / <85 s (battery)	< 30 s
ONE T 24 FDCU ST	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W	1mA...1A 60V	< 75 s (cabled) / <85 s (battery)	< 30 s
ONE T 230 FDCU	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W	1mA...100mA 230V	< 75 s (cabled) / <85 s (battery)	< 30 s
ONE T 230 FDCU ST	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W	1mA...100mA 230V	< 75 s (cabled) / <85 s (battery)	< 30 s
ONE T 24 FDCB	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W	1mA...1A 60V	< 75 s (cabled) / <85 s (battery)	< 30 s
ONE T 230 FDCB	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W	1mA...1A 60V	< 75 s (cabled) / <85 s (battery)	< 30 s
ONE-X 24	24 V AC/DC (-10/+20%)	N/A	0,28 W	4,2 W		< 75 s (cabled) / <85 s (battery)	< 30 s
ONE-X 230	230 V AC (-15/+15%)	N/A	0,57 W	4,2 W		< 75 s (cabled) / <85 s (battery)	< 30 s
BFL24	24 V AC/DC	N/A	0,7 W	2,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFL24-ST	24 V AC/DC	N/A	0,7 W	2,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFL230	230 V AC	N/A	0,9 W	3 W	1mA...3A, AC 250V	< 60 s	20 s
BFLT24	24 V AC/DC	N/A	0,8 W	2,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFLT24-ST	24 V AC/DC	N/A	0,8 W	2,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFLT230	230 V AC	N/A	1,1 W	3,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFLT230-ST	230 V AC	N/A	1,1 W	3,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFN24	24 V AC/DC	N/A	1,4 W	4 W	1mA...3A, AC 250V	< 60 s	20 s
BFN24-ST	24 V AC/DC	N/A	1,4 W	4 W	1mA...3A, AC 250V	< 60 s	20 s
BFN230	230 V AC	N/A	2 W	4,5 W	1mA...3A, AC 250V	< 60 s	20 s
BFNT24	24 V AC/DC	N/A	1,4 W	4 W	1mA...3A, AC 250V	< 60 s	20 s
BFNT24-ST	24 V AC/DC	N/A	1,4 W	4 W	1mA...3A, AC 250V	< 60 s	20 s
BFNT230	230 V AC	N/A	2,1 W	5 W	1mA...3A, AC 250V	< 60 s	20 s
BFNT230-ST	230 V AC	N/A	2,1 W	5 W	1mA...3A, AC 250V	< 60 s	20 s

MEC	Running time spring	Noise level motor	Noise level spring	Cable supply / control	Cable auxiliary switch	Protection class
CFTH	1 s	N/A	N/A			IP 42
ONE T 24 FDCU	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
ONE T 24 FDCU ST	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
ONE T 230 FDCU	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
ONE T 230 FDCU ST	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
ONE T 24 FDCB	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	(2x) 1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
ONE T 230 FDCB	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	(2x) 1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
ONE-X 24	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	bus cable: (2x) 1 m, 4 x 0,75 mm ² (halogen-free)	IP 54
ONE-X 230	< 30 s	< 64 dB (A)	< 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	bus cable: (2x) 1 m, 4 x 0,75 mm ² (halogen-free)	IP 54
BFL24	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFL24-ST	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFL230	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFLT24	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFLT24-ST	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFLT230	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFLT230-ST	20 s	< 43 dB (A)	< 62 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFN24	20 s	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFN24-ST	20 s	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFN230	20 s	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFNT24	20 s	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFNT24-ST	20 s	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFNT230	20 s	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54
BFNT230-ST	20 s	≤ 55 dB (A)	ca. 67 dB (A)	1 m, 2 x 0.75 mm ² (halogen-free)	1 m, 6 x 0.75 mm ² (halogen-free)	IP 54

Hn\Wn [mm]	950	1000	1050	1100	1150	1200							
200	kg	30,2	31,5	32,7	33,9	35,1	36,3						
250	kg	33,3	34,6	35,9	37,3	38,6	40,0						
300	kg	36,3	37,7	39,2	40,7	42,1	43,6						
350	kg	39,3	40,9	42,5	44,0	45,6	47,2						
400	kg	42,3	44,0	45,7	47,4	49,1	50,8						
450	kg	45,3	47,1	49,0	50,8	52,6	54,4						
500	kg	48,3	50,3	52,2	54,2	56,1	58,0						
550	kg	51,4	53,4	55,5	57,5	59,6	61,7						
600	kg	54,4	56,6	58,7	60,9	63,1	65,3						
650	kg	57,4	59,7	62,0	64,3	66,6	68,9						
700	kg	60,4	62,8	65,2	67,7	70,1	72,5						
750	kg	63,4	66,0	68,5	71,0	73,6	76,1						
800	kg	66,4	69,1	71,8	74,4	77,1	79,7						

CU2-15 + BFL

CU2-15 + BFLT

CU2-15 + BFN

Hn\Wn [mm]	200	250	300	350	400	450	500	550	600	650	700	750	800	850	900
200 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
250 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
300 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	-	37,3
400 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	38,5	40,2
450 kg	-	-	-	-	-	-	-	-	-	-	-	-	39,4	41,2	43,1
500 kg	-	-	-	-	-	-	-	-	-	-	-	40,1	42,1	44,0	45,9
550 kg	-	-	-	-	-	-	-	-	-	-	40,6	42,7	44,7	46,8	48,8
600 kg	-	-	-	-	-	-	-	-	-	40,8	43,0	45,2	47,4	49,6	51,7
650 kg	-	-	-	-	-	-	-	-	40,8	43,1	45,4	47,7	50,0	52,3	54,6
700 kg	-	-	-	-	-	-	-	40,6	43,0	45,4	47,9	50,3	52,7	55,1	57,5
750 kg	-	-	-	-	-	-	40,1	42,7	45,2	47,7	50,3	52,8	55,4	57,9	60,4
800 kg	-	-	-	-	-	39,4	42,1	44,7	47,4	50,0	52,7	55,4	58,0	60,7	63,3

Hn\Wn [mm]	950	1000	1050	1100	1150	1200									
200 kg	-	-	32,2	33,5	34,7	35,9									
250 kg	-	34,1	35,5	36,8	38,2	39,5									
300 kg	35,8	37,3	38,7	40,2	41,7	43,1									
350 kg	38,8	40,4	42,0	43,6	45,2	46,7									
400 kg	41,9	43,6	45,3	47,0	48,7	50,4									
450 kg	44,9	46,7	48,5	50,3	52,2	54,0									
500 kg	47,9	49,8	51,8	53,7	55,6	57,6									
550 kg	50,9	53,0	55,0	57,1	59,1	61,2									
600 kg	53,9	56,1	58,3	60,5	62,6	64,8									
650 kg	56,9	59,2	61,5	63,8	66,1	68,4									
700 kg	60,0	62,4	64,8	67,2	69,6	72,1									
750 kg	63,0	65,5	68,1	70,6	73,1	75,7									
800 kg	66,0	68,6	71,3	74,0	76,6	79,3									

CU2-15 + BFNT

Hn\Wn [mm]	200	250	300	350	400	450	500	550	600	650	700	750	800	850	900
200 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
250 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
300 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-
350 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	-	37,4
400 kg	-	-	-	-	-	-	-	-	-	-	-	-	-	38,6	40,3
450 kg	-	-	-	-	-	-	-	-	-	-	-	-	39,5	41,3	43,2
500 kg	-	-	-	-	-	-	-	-	-	-	-	40,2	42,2	44,1	46,0
550 kg	-	-	-	-	-	-	-	-	-	-	40,7	42,8	44,8	46,9	48,9
600 kg	-	-	-	-	-	-	-	-	-	40,9	43,1	45,3	47,5	49,7	51,8
650 kg	-	-	-	-	-	-	-	-	40,9	43,2	45,5	47,8	50,1	52,4	54,7
700 kg	-	-	-	-	-	-	-	40,7	43,1	45,5	48,0	50,4	52,8	55,2	57,6
750 kg	-	-	-	-	-	-	40,2	42,8	45,3	47,8	50,4	52,9	55,5	58,0	60,5
800 kg	-	-	-	-	-	39,5	42,2	44,8	47,5	50,1	52,8	55,5	58,1	60,8	63,4

Selection data

Hn\Wn [mm]	950	1000	1050	1100	1150	1200							
200	kg	-	-	32,3	33,6	34,8	36,0						
250	kg	-	34,2	35,6	36,9	38,3	39,6						
300	kg	35,9	37,4	38,8	40,3	41,8	43,2						
350	kg	38,9	40,5	42,1	43,7	45,3	46,8						
400	kg	42,0	43,7	45,4	47,1	48,8	50,5						
450	kg	45,0	46,8	48,6	50,4	52,3	54,1						
500	kg	48,0	49,9	51,9	53,8	55,7	57,7						
550	kg	51,0	53,1	55,1	57,2	59,2	61,3						
600	kg	54,0	56,2	58,4	60,6	62,7	64,9						
650	kg	57,0	59,3	61,6	63,9	66,2	68,5						
700	kg	60,1	62,5	64,9	67,3	69,7	72,2						
750	kg	63,1	65,6	68,2	70,7	73,2	75,8						
800	kg	66,1	68,7	71,4	74,1	76,7	79,4						

Selection data

$$\Delta p \text{ [Pa]} = \zeta^* v^{2*} 0,6$$

Hn\Wn [mm]	200	250	300	350	400	450	500	550	600	650	700	750	800	850	900	
200	$\zeta[-]$	8,46	7,33	6,67	6,25	5,95	5,73	5,56	5,42	5,31	5,22	5,14	5,08	5,02	4,97	4,93
250	$\zeta[-]$	4,44	3,68	3,24	2,96	2,77	2,63	2,52	2,44	2,37	2,31	2,26	2,22	2,19	2,16	2,13
300	$\zeta[-]$	2,92	2,32	1,99	1,79	1,64	1,54	1,46	1,4	1,35	1,31	1,27	1,25	1,22	1,2	1,18
350	$\zeta[-]$	2,16	1,67	1,4	1,23	1,11	1,03	0,97	0,92	0,88	0,85	0,82	0,8	0,78	0,77	0,75
400	$\zeta[-]$	1,72	1,29	1,06	0,92	0,82	0,75	0,7	0,66	0,63	0,6	0,58	0,56	0,55	0,53	0,52
450	$\zeta[-]$	1,44	1,06	0,85	0,73	0,64	0,58	0,54	0,5	0,48	0,45	0,44	0,42	0,41	0,4	0,39
500	$\zeta[-]$	1,25	0,9	0,71	0,6	0,52	0,47	0,43	0,4	0,38	0,36	0,34	0,33	0,32	0,31	0,3
550	$\zeta[-]$	1,13	0,8	0,63	0,52	0,46	0,41	0,37	0,34	0,32	0,3	0,29	0,28	0,27	0,26	0,25
600	$\zeta[-]$	1,02	0,71	0,55	0,45	0,39	0,35	0,31	0,29	0,27	0,25	0,24	0,23	0,22	0,21	0,21
650	$\zeta[-]$	0,94	0,64	0,49	0,4	0,34	0,3	0,27	0,25	0,23	0,22	0,2	0,19	0,19	0,18	0,17
700	$\zeta[-]$	0,87	0,59	0,44	0,36	0,3	0,27	0,24	0,22	0,2	0,19	0,18	0,17	0,16	0,15	0,15
750	$\zeta[-]$	0,81	0,54	0,41	0,33	0,27	0,24	0,21	0,19	0,18	0,16	0,15	0,15	0,14	0,13	0,13
800	$\zeta[-]$	0,77	0,51	0,38	0,3	0,25	0,22	0,19	0,17	0,16	0,15	0,14	0,13	0,12	0,12	0,11

Hn\Wn [mm]	950	1000	1050	1100	1150	1200							
200	$\zeta[-]$	4,89	4,86	4,83	4,8	4,77	4,75						
250	$\zeta[-]$	2,11	2,09	2,07	2,05	2,04	2,02						
300	$\zeta[-]$	1,16	1,15	1,14	1,12	1,11	1,1						
350	$\zeta[-]$	0,74	0,73	0,72	0,71	0,7	0,69						
400	$\zeta[-]$	0,51	0,5	0,5	0,49	0,48	0,48						
450	$\zeta[-]$	0,38	0,37	0,36	0,36	0,35	0,35						
500	$\zeta[-]$	0,29	0,29	0,28	0,27	0,27	0,27						
550	$\zeta[-]$	0,24	0,24	0,23	0,23	0,22	0,22						
600	$\zeta[-]$	0,2	0,19	0,19	0,19	0,18	0,18						
650	$\zeta[-]$	0,17	0,16	0,16	0,15	0,15	0,15						
700	$\zeta[-]$	0,14	0,14	0,13	0,13	0,13	0,13						
750	$\zeta[-]$	0,12	0,12	0,12	0,11	0,11	0,11						
800	$\zeta[-]$	0,11	0,1	0,1	0,1	0,1	0,09						

Example

Data

$H_n = 400 \text{ mm}$, $W_n = 500 \text{ mm}$, $v = 4 \text{ m/s}$

Calculation

$$\Delta p = 0.70 * (4 \text{ m/s})^2 * 0.6 = 6.72 \text{ Pa}$$

CU2-15

$H_n \backslash W_n \text{ [mm]}$	200	250	300	350	400	450	500	550	600	650	700	
200	Sn [m^2]	0,0128	0,0173	0,0217	0,0262	0,0306	0,0351	0,0395	0,0440	0,0484	0,0529	0,0573
	Sn [%]	34,05	36,48	38,07	39,21	40,05	40,71	41,23	41,66	42,01	42,31	42,57
250	Sn [m^2]	0,0200	0,0270	0,0339	0,0409	0,0478	0,0548	0,0617	0,0687	0,0756	0,0826	0,0895
	Sn [%]	42,28	45,29	47,28	48,69	49,74	50,55	51,20	51,73	52,17	52,54	52,86
300	Sn [m^2]	0,0272	0,0367	0,0461	0,0556	0,0650	0,0745	0,0839	0,0934	0,1028	0,1123	0,1217
	Sn [%]	47,72	51,11	53,35	54,94	56,13	57,05	57,78	58,38	58,87	59,29	59,65
350	Sn [m^2]	0,0344	0,0464	0,0583	0,0703	0,0822	0,0942	0,1061	0,1181	0,1300	0,1420	0,1539
	Sn [%]	51,57	55,24	57,66	59,38	60,66	61,65	62,44	63,09	63,63	64,08	64,47
400	Sn [m^2]	0,0416	0,0561	0,0705	0,0850	0,0994	0,1139	0,1283	0,1428	0,1572	0,1717	0,1861
	Sn [%]	54,45	58,32	60,88	62,69	64,04	65,09	65,93	66,61	67,18	67,66	68,07
450	Sn [m^2]	0,0488	0,0658	0,0827	0,0997	0,1166	0,1336	0,1505	0,1675	0,1844	0,2014	0,2183
	Sn [%]	56,67	60,71	63,37	65,25	66,66	67,75	68,62	69,33	69,92	70,42	70,85
500	Sn [m^2]	0,0546	0,0735	0,0925	0,1114	0,1304	0,1493	0,1683	0,1872	0,2062	0,2251	0,2441
	Sn [%]	56,95	61,00	63,67	65,57	66,98	68,08	68,96	69,67	70,26	70,76	71,19
550	Sn [m^2]	0,0618	0,0832	0,1047	0,1261	0,1476	0,1690	0,1905	0,2119	0,2334	0,2548	0,2763
	Sn [%]	58,54	62,70	65,45	67,40	68,85	69,98	70,88	71,61	72,22	72,74	73,18
600	Sn [m^2]	0,0690	0,0929	0,1169	0,1408	0,1648	0,1887	0,2127	0,2366	0,2606	0,2845	0,3085
	Sn [%]	59,86	64,12	66,93	68,92	70,41	71,56	72,48	73,23	73,85	74,38	74,83
650	Sn [m^2]	0,0762	0,1026	0,1291	0,1555	0,1820	0,2084	0,2349	0,2613	0,2878	0,3142	0,3407
	Sn [%]	60,97	65,31	68,17	70,20	71,72	72,89	73,83	74,59	75,23	75,77	76,22
700	Sn [m^2]	0,0834	0,1123	0,1413	0,1702	0,1992	0,2281	0,2571	0,2860	0,3150	0,3439	0,3729
	Sn [%]	61,93	66,33	69,24	71,30	72,84	74,03	74,99	75,76	76,41	76,95	77,42
750	Sn [m^2]	0,0906	0,1220	0,1535	0,1849	0,2164	0,2478	0,2793	0,3107	0,3422	0,3736	0,4051
	Sn [%]	62,75	67,22	70,16	72,25	73,81	75,02	75,99	76,77	77,43	77,98	78,45
800	Sn [m^2]	0,0978	0,1317	0,1657	0,1996	0,2336	0,2675	0,3015	0,3354	0,3694	0,4033	0,4373
	Sn [%]	63,48	67,99	70,97	73,09	74,66	75,89	76,86	77,66	78,32	78,88	79,36

$H_n \backslash W_n \text{ [mm]}$	750	800	850	900	950	1000	1050	1100	1150	1200		
200	Sn [m^2]	0,0618	0,0662	0,0707	0,0751	0,0796	0,0840	0,0885	0,0929	0,0974	0,1018	
	Sn [%]	42,79	42,99	43,16	43,31	43,45	43,57	43,68	43,78	43,87	43,96	
250	Sn [m^2]	0,0965	0,1034	0,1104	0,1173	0,1243	0,1312	0,1382	0,1451	0,1521	0,1590	
	Sn [%]	53,14	53,38	53,59	53,78	53,95	54,10	54,24	54,36	54,48	54,58	
300	Sn [m^2]	0,1312	0,1406	0,1501	0,1595	0,1690	0,1784	0,1879	0,1973	0,2068	0,2162	
	Sn [%]	59,97	60,24	60,48	60,69	60,88	61,05	61,21	61,35	61,48	61,59	
350	Sn [m^2]	0,1659	0,1778	0,1898	0,2017	0,2137	0,2256	0,2376	0,2495	0,2615	0,2734	
	Sn [%]	64,81	65,10	65,36	65,59	65,80	65,98	66,15	66,30	66,44	66,57	
400	Sn [m^2]	0,2006	0,2150	0,2295	0,2439	0,2584	0,2728	0,2873	0,3017	0,3162	0,3306	
	Sn [%]	68,42	68,73	69,00	69,25	69,47	69,66	69,84	70,00	70,14	70,28	

Selection data

Hn\Wn [mm]	750	800	850	900	950	1000	1050	1100	1150	1200	
450	Sn [m ²]	0,2353	0,2522	0,2692	0,2861	0,3031	0,3200	0,3370	0,3539	0,3709	0,3878
	Sn [%]	71,22	71,54	71,83	72,08	72,31	72,51	72,69	72,86	73,01	73,15
500	Sn [m ²]	0,2630	0,2820	0,3009	0,3199	0,3388	0,3578	0,3767	0,3957	0,4146	0,4336
	Sn [%]	71,56	71,89	72,18	72,43	72,66	72,86	73,05	73,21	73,37	73,51
550	Sn [m ²]	0,2977	0,3192	0,3406	0,3621	0,3835	0,4050	0,4264	0,4479	0,4693	0,4908
	Sn [%]	73,56	73,89	74,19	74,45	74,68	74,89	75,08	75,26	75,41	75,56
600	Sn [m ²]	0,3324	0,3564	0,3803	0,4043	0,4282	0,4522	0,4761	0,5001	0,5240	0,5480
	Sn [%]	75,22	75,56	75,86	76,13	76,37	76,58	76,78	76,95	77,12	77,26
650	Sn [m ²]	0,3671	0,3936	0,4200	0,4465	0,4729	0,4994	0,5258	0,5523	0,5787	0,6052
	Sn [%]	76,62	76,97	77,28	77,55	77,79	78,01	78,21	78,39	78,55	78,70
700	Sn [m ²]	0,4018	0,4308	0,4597	0,4887	0,5176	0,5466	0,5755	0,6045	0,6334	0,6624
	Sn [%]	77,82	78,18	78,49	78,76	79,01	79,23	79,43	79,62	79,78	79,94
750	Sn [m ²]	0,4365	0,4680	0,4994	0,5309	0,5623	0,5938	0,6252	0,6567	0,6881	0,7196
	Sn [%]	78,86	79,22	79,53	79,81	80,07	80,29	80,49	80,68	80,85	81,00
800	Sn [m ²]	0,4712	0,5052	0,5391	0,5731	0,6070	0,6410	0,6749	0,7089	0,7428	0,7768
	Sn [%]	79,77	80,13	80,45	80,73	80,99	81,21	81,42	81,61	81,78	81,94

CU2-15L

Hn\Wn [mm]	200	250	300	350	400	450	500	550	600	650	700
200	Sn [m ²]	0,0128	0,0173	0,0217	0,0262	0,0306	0,0351	0,0395	0,0440	0,0484	0,0529
	Sn [%]	34,05	36,48	38,07	39,21	40,05	40,71	41,23	41,66	42,01	42,31
250	Sn [m ²]	0,0200	0,0270	0,0339	0,0409	0,0478	0,0548	0,0617	0,0687	0,0756	0,0826
	Sn [%]	42,28	45,29	47,28	48,69	49,74	50,55	51,20	51,73	52,17	52,54
300	Sn [m ²]	0,0272	0,0367	0,0461	0,0556	0,0650	0,0745	0,0839	0,0934	0,1028	0,1123
	Sn [%]	47,72	51,11	53,35	54,94	56,13	57,05	57,78	58,38	58,87	59,29
350	Sn [m ²]	0,0344	0,0464	0,0583	0,0703	0,0822	0,0942	0,1061	0,1181	0,1300	0,1420
	Sn [%]	51,57	55,24	57,66	59,38	60,66	61,65	62,44	63,09	63,63	64,08
400	Sn [m ²]	0,0416	0,0561	0,0705	0,0850	0,0994	0,1139	0,1283	0,1428	0,1572	0,1717
	Sn [%]	54,45	58,32	60,88	62,69	64,04	65,09	65,93	66,61	67,18	67,66
450	Sn [m ²]	0,0488	0,0658	0,0827	0,0997	0,1166	0,1336	0,1505	0,1675	0,1844	0,2014
	Sn [%]	56,67	60,71	63,37	65,25	66,66	67,75	68,62	69,33	69,92	70,42
500	Sn [m ²]	0,0546	0,0735	0,0925	0,1114	0,1304	0,1493	0,1683	0,1872	0,2062	0,2251
	Sn [%]	56,95	61,00	63,67	65,57	66,98	68,08	68,96	69,67	70,26	70,76
550	Sn [m ²]	0,0618	0,0832	0,1047	0,1261	0,1476	0,1690	0,1905	0,2119	0,2334	0,2548
	Sn [%]	58,54	62,70	65,45	67,40	68,85	69,98	70,88	71,61	72,22	72,74
600	Sn [m ²]	0,0690	0,0929	0,1169	0,1408	0,1648	0,1887	0,2127	0,2366	0,2606	0,2845
	Sn [%]	59,86	64,12	66,93	68,92	70,41	71,56	72,48	73,23	73,85	74,38
650	Sn [m ²]	0,0762	0,1026	0,1291	0,1555	0,1820	0,2084	0,2349	0,2613	0,2878	0,3142
	Sn [%]	60,97	65,31	68,17	70,20	71,72	72,89	73,83	74,59	75,23	75,77
700	Sn [m ²]	0,0834	0,1123	0,1413	0,1702	0,1992	0,2281	0,2571	0,2860	0,3150	0,3439
	Sn [%]	61,93	66,33	69,24	71,30	72,84	74,03	74,99	75,76	76,41	76,95
750	Sn [m ²]	0,0906	0,1220	0,1535	0,1849	0,2164	0,2478	0,2793	0,3107	0,3422	0,3736
	Sn [%]	62,75	67,22	70,16	72,25	73,81	75,02	75,99	76,77	77,43	77,98
800	Sn [m ²]	0,0978	0,1317	0,1657	0,1996	0,2336	0,2675	0,3015	0,3354	0,3694	0,4033
	Sn [%]	63,48	67,99	70,97	73,09	74,66	75,89	76,86	77,66	78,32	79,36

Hn\Wn [mm]	750	800	850	900	950	1000	1050	1100	1150	1200	
200	Sn [m^2]	0,0618	0,0662	0,0707	0,0751	0,0796	0,0840	0,0885	0,0929	0,0974	0,1018
	Sn [%]	42,79	42,99	43,16	43,31	43,45	43,57	43,68	43,78	43,87	43,96
250	Sn [m^2]	0,0965	0,1034	0,1104	0,1173	0,1243	0,1312	0,1382	0,1451	0,1521	0,1590
	Sn [%]	53,14	53,38	53,59	53,78	53,95	54,10	54,24	54,36	54,48	54,58
300	Sn [m^2]	0,1312	0,1406	0,1501	0,1595	0,1690	0,1784	0,1879	0,1973	0,2068	0,2162
	Sn [%]	59,97	60,24	60,48	60,69	60,88	61,05	61,21	61,35	61,48	61,59
350	Sn [m^2]	0,1659	0,1778	0,1898	0,2017	0,2137	0,2256	0,2376	0,2495	0,2615	0,2734
	Sn [%]	64,81	65,10	65,36	65,59	65,80	65,98	66,15	66,30	66,44	66,57
400	Sn [m^2]	0,2006	0,2150	0,2295	0,2439	0,2584	0,2728	0,2873	0,3017	0,3162	0,3306
	Sn [%]	68,42	68,73	69,00	69,25	69,47	69,66	69,84	70,00	70,14	70,28
450	Sn [m^2]	0,2353	0,2522	0,2692	0,2861	0,3031	0,3200	0,3370	0,3539	0,3709	0,3878
	Sn [%]	71,22	71,54	71,83	72,08	72,31	72,51	72,69	72,86	73,01	73,15
500	Sn [m^2]	0,2630	0,2820	0,3009	0,3199	0,3388	0,3578	0,3767	0,3957	0,4146	0,4336
	Sn [%]	71,56	71,89	72,18	72,43	72,66	72,86	73,05	73,21	73,37	73,51
550	Sn [m^2]	0,2977	0,3192	0,3406	0,3621	0,3835	0,4050	0,4264	0,4479	0,4693	0,4908
	Sn [%]	73,56	73,89	74,19	74,45	74,68	74,89	75,08	75,26	75,41	75,56
600	Sn [m^2]	0,3324	0,3564	0,3803	0,4043	0,4282	0,4522	0,4761	0,5001	0,5240	0,5480
	Sn [%]	75,22	75,56	75,86	76,13	76,37	76,58	76,78	76,95	77,12	77,26
650	Sn [m^2]	0,3671	0,3936	0,4200	0,4465	0,4729	0,4994	0,5258	0,5523	0,5787	0,6052
	Sn [%]	76,62	76,97	77,28	77,55	77,79	78,01	78,21	78,39	78,55	78,70
700	Sn [m^2]	0,4018	0,4308	0,4597	0,4887	0,5176	0,5466	0,5755	0,6045	0,6334	0,6624
	Sn [%]	77,82	78,18	78,49	78,76	79,01	79,23	79,43	79,62	79,78	79,94
750	Sn [m^2]	0,4365	0,4680	0,4994	0,5309	0,5623	0,5938	0,6252	0,6567	0,6881	0,7196
	Sn [%]	78,86	79,22	79,53	79,81	80,07	80,29	80,49	80,68	80,85	81,00
800	Sn [m^2]	0,4712	0,5052	0,5391	0,5731	0,6070	0,6410	0,6749	0,7089	0,7428	0,7768
	Sn [%]	79,77	80,13	80,45	80,73	80,99	81,21	81,42	81,61	81,78	81,94

Sample order

Sample order

CU2-15	400	300	PG30	PM	CFTH	FCU
1	2	3	4	5	6	7

1. product
2. width
3. height
4. frame on the side of the mechanism
5. frame on the side of the wall
6. mechanism type
7. option: uni/bipolar switches

Approvals and certificates

All our dampers are submitted to a number of tests by official test institutes. Reports of these tests form the basis for the approvals of our dampers.



0749-CPR-BC1-606-0464-15650.04-0464&2517

18.13



2822-UKCA-CPR-0058

The NF-label guarantees: conformity with the standard NF S 61-937 Parts 1 and 5: "Systèmes de Sécurité Incendie Dispositifs Actionnés de Sécurité"; conformity with the national decree of March 22, 2004, changed on 14 March 2011 for the classification of fire resistance; the values of the characteristics mentioned in this document. Organisme Certificateur: AFNOR Certification, 11 Rue Francis de Pressensé, F93571 La Plaine Saint-Denis Cedex; Website: <http://www.afnor.org> and <http://www.marque-nf.com>; Phone: +33 (0)1.41.62.80.00, Fax: +33 (0)1.49.17.90.00, Email: certification@afnor.org